


Pile Dynamics, Inc. Transducer 101M

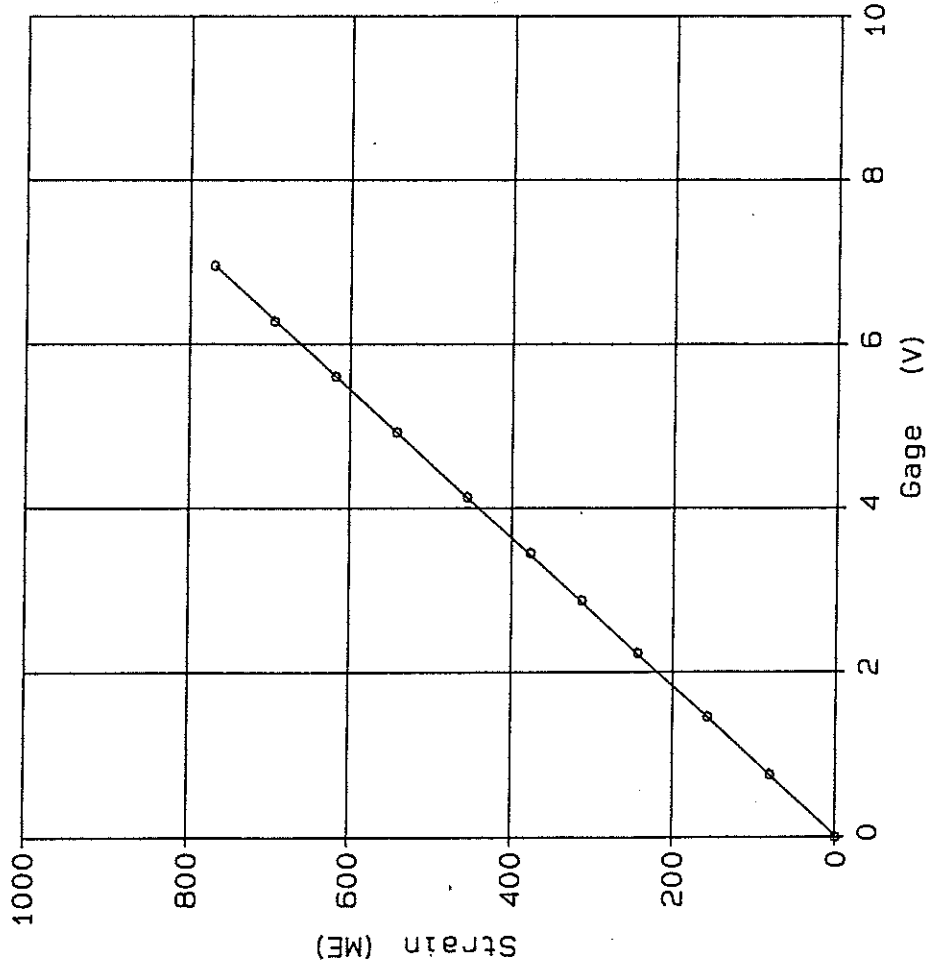

PDA Cal Factor = 110.7 ME/V
 Shunt (60.4KO) = 5.0 V
 General Factor = 384.3 ME/mV/V
 Traceable to N.I.S.T.

Strain ME	Gage V
0	.00
81	.75
158	1.46
244	2.23
313	2.87
378	3.45
455	4.14
542	4.93
619	5.61
694	6.28
769	6.96

Calibrated by: Jim Sautter
 Calibrated on: 09-May-95