


Pile Dynamics, Inc. Transducer 102M

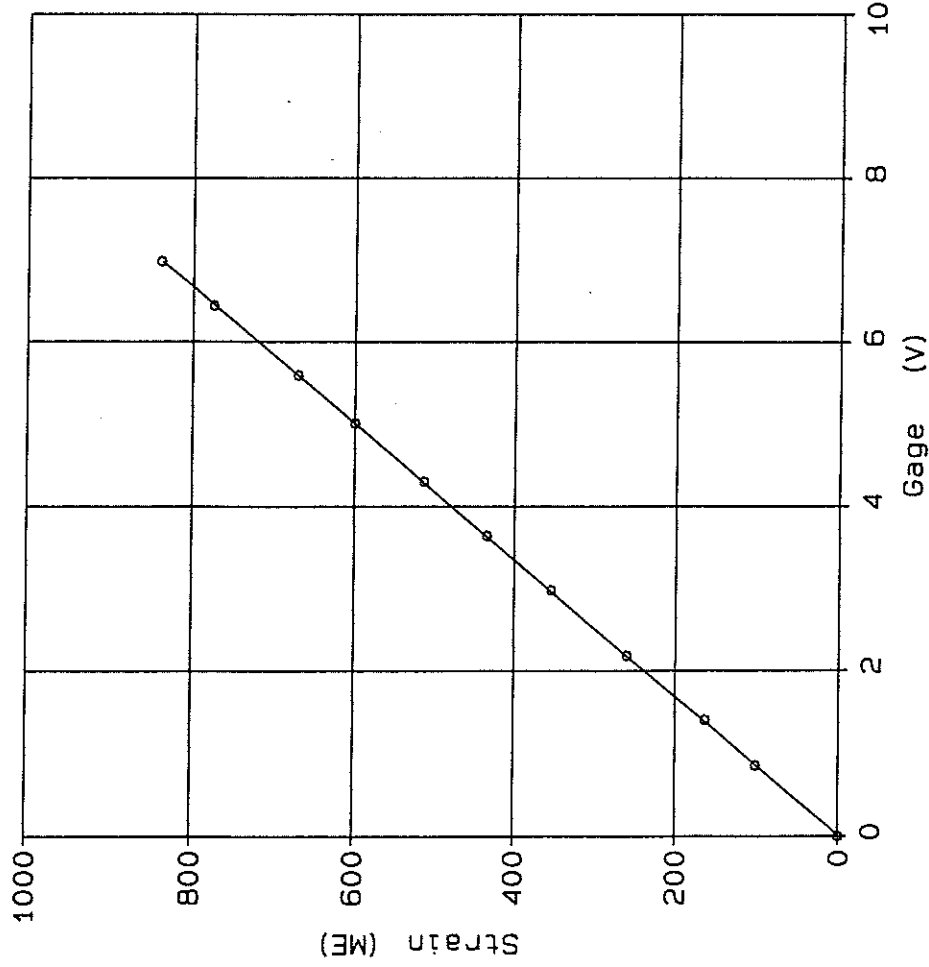

PDA Cal Factor = 120.3 ME/V
 Shunt (60.4K Ω) = 5.0 V
 General Factor = 417.8 ME/mV/V
 Traceable to N.I.S.T.

Strain ME	Gage V
0	.00
101	.85
165	1.40
259	2.19
355	2.99
434	3.65
514	4.30
601	5.01
671	5.59
774	6.44
838	6.98

Calibrated by: *Jim Denton*
 Calibrated on: 09-May-95