


Pile Dynamics, Inc. Transducer 103M

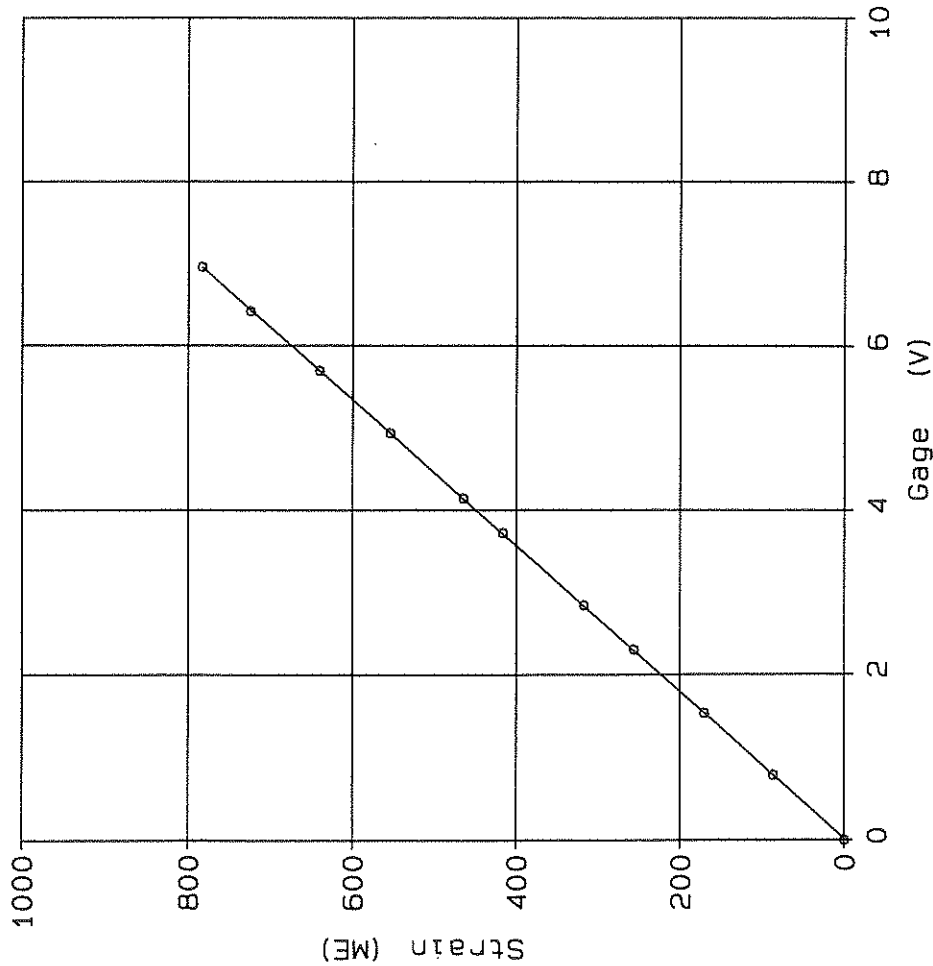

PDA Cal Factor = 112.9 ME/V
 Shunt (60.4KΩ) = 5.0 V

 General Factor = 391.9 ME/mV/V
 Traceable to N.I.S.T.

Strain ME	Gage V
0	.00
87	.78
171	1.54
256	2.30
317	2.84
417	3.72
465	4.15
554	4.93
641	5.70
725	6.43
784	6.96

Calibrated by: *Jim Duntz*
 Calibrated on: 09-May-95