


Pile Dynamics, Inc. Transducer 108M

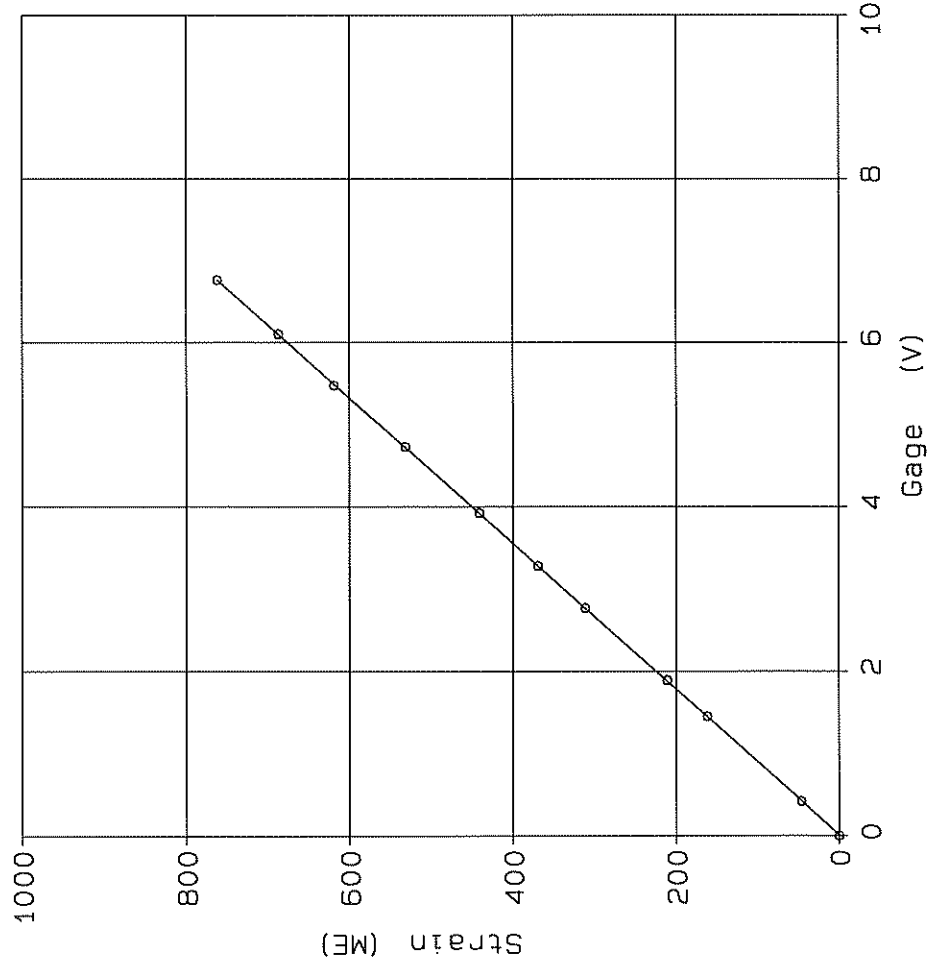

PDA Cal Factor = 112.8 ME/V
 Shunt (60.4K Ω) = 5.0 V
 General Factor = 391.6 ME/mV/V
 Traceable to N.I.S.T.

Strain ME	Gage V
0	.00
47	.43
163	1.46
212	1.89
311	2.78
369	3.28
441	3.93
532	4.74
619	5.49
687	6.11
762	6.77

Calibrated by: *J.S. Antkowiak*

Calibrated on: 10-Feb-96