


Pile Dynamics, Inc. Transducer 109M

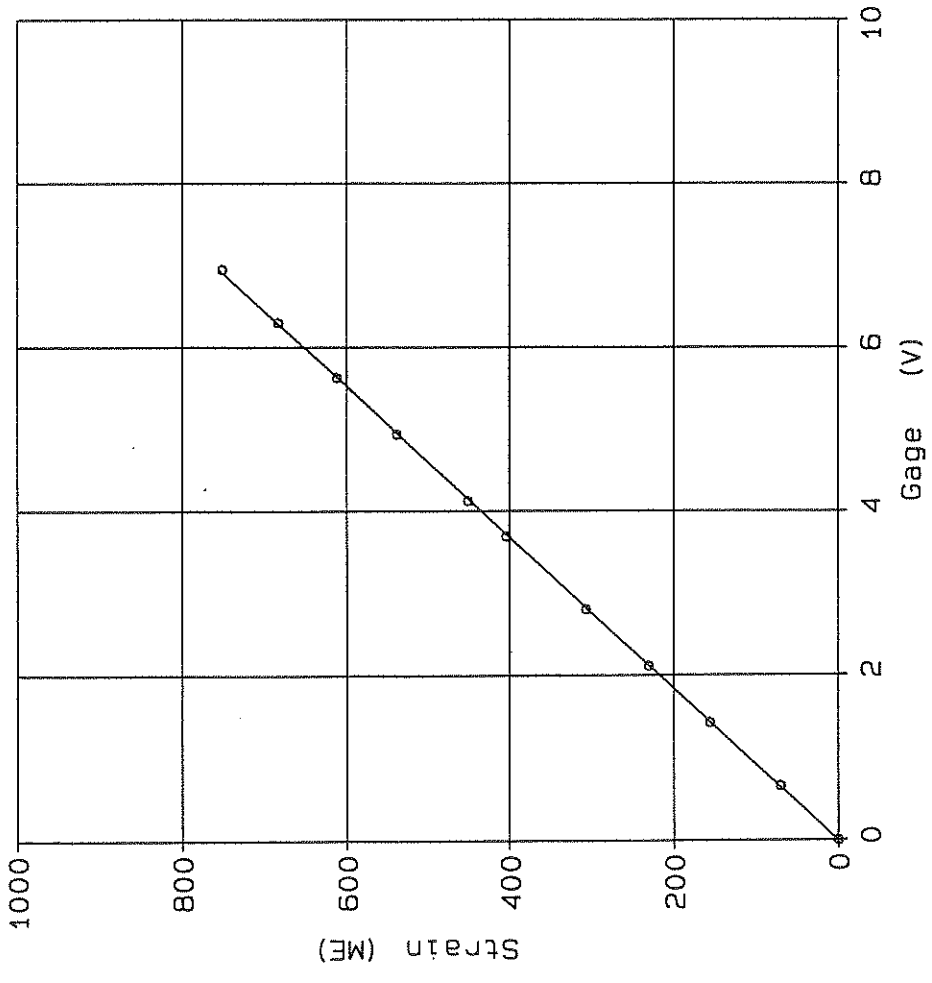

PDA Cal Factor = 108.4 ME/V
 Shunt (60.4K Ω) = 5.0 V
 General Factor = 376.2 ME/mV/V
 Traceable to N.I.S.T.

Strain ME	Gage V
0	.00
71	.66
156	1.43
232	2.12
307	2.80
405	3.70
451	4.13
539	4.93
612	5.63
683	6.30
751	6.95

Calibrated by: James E. Dinkley
 Calibrated on: 13-Sep-95