


Pile Dynamics, Inc. Transducer 111M

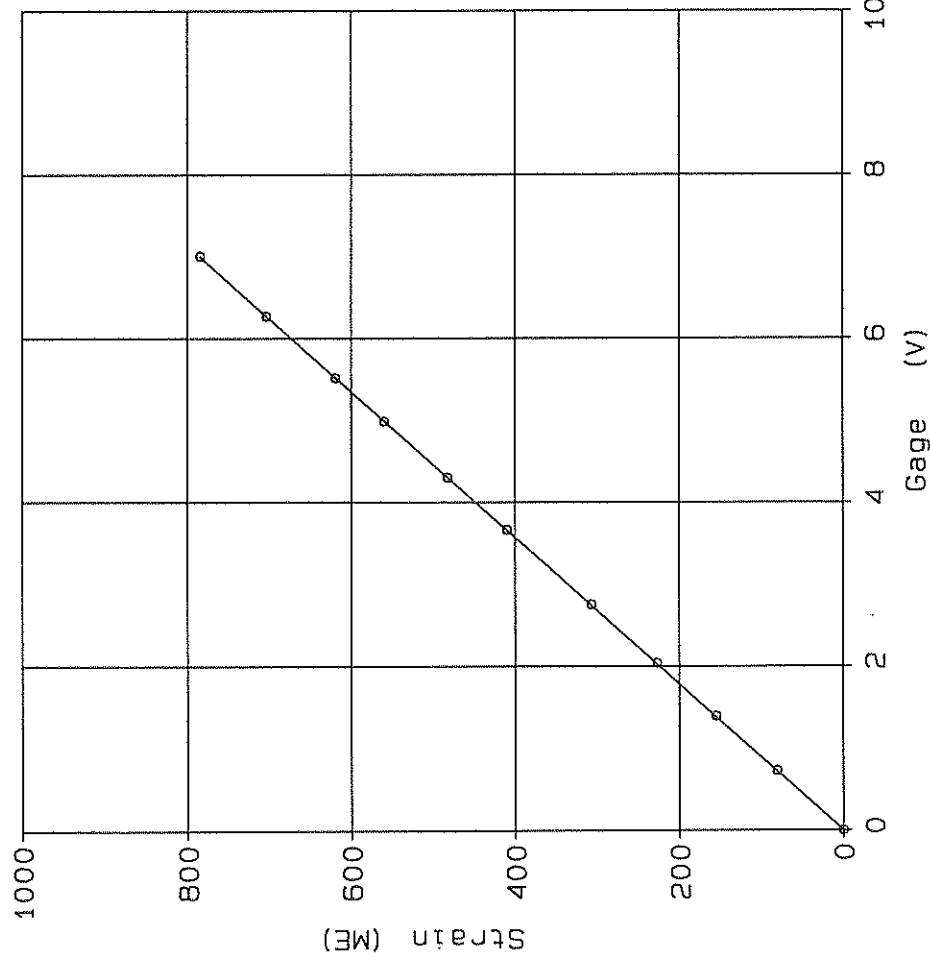

PDA Cal Factor = 112.3 ME/V
 Shunt (60.4KΩ) = 5.0 V
 General Factor = 389.9 ME/mV/V
 Traceable to N.I.S.T.

Strain ME	Gage V
0	.00
81	.74
156	1.40
227	2.05
307	2.75
411	3.67
483	4.31
560	4.99
620	5.52
704	6.28
784	7.00

Calibrated by: Jim Sauter
 Calibrated on: 23-Oct-95