


Pile Dynamics, Inc. Transducer 119W

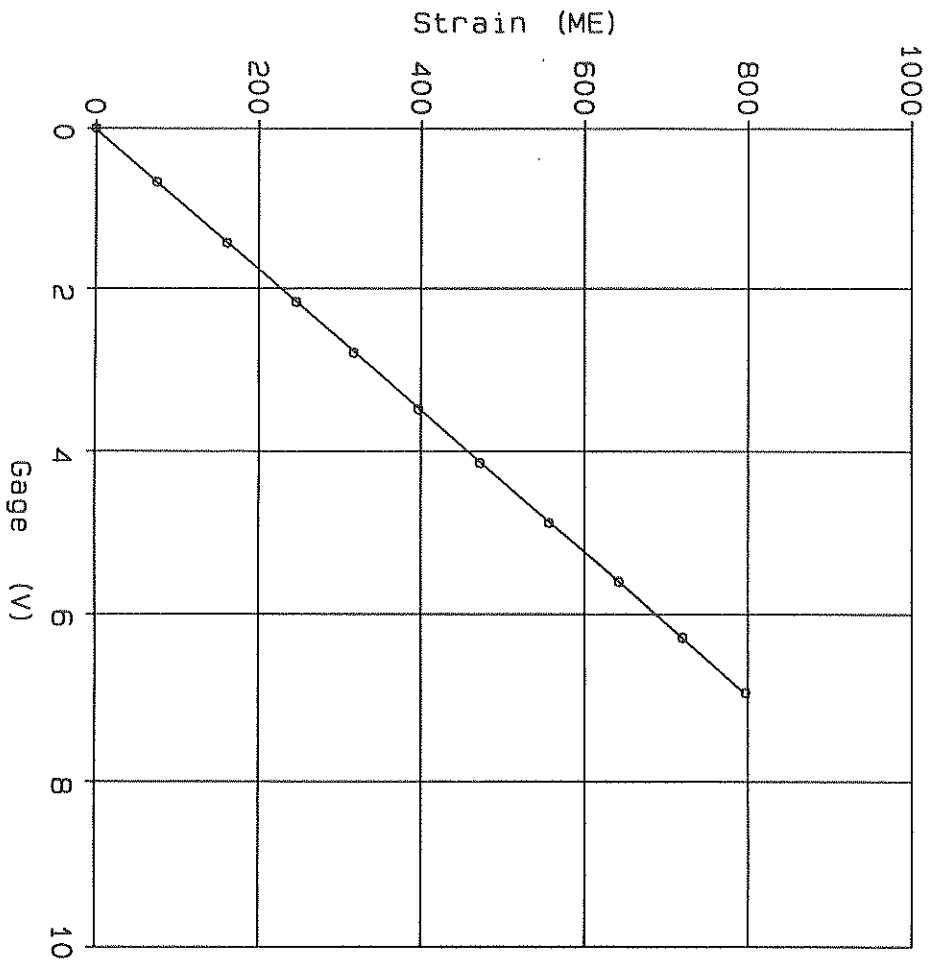

PDA Cal Factor = 114.9 ME/V
 Shunt (60.4K0) = 5.0 V
 General Factor = 398.8 ME/mV/V
 Traceable to N.I.S.T. *

Strain ME	Gage V
0	.00
76	.68
162	1.43
246	2.18
318	2.80
397	3.50
472	4.15
558	4.88
642	5.61
720	6.28
797	6.95

Calibrated by: *J. S. Smith*
 Calibrated on: 28-May-96