

Pile Dynamics, Inc.


Pile Dynamics, Inc.

Transducer 195D

Strain ($\mu\epsilon$)

PDA Cal Factor (5.0 V)

114.6 $\mu\epsilon/V$

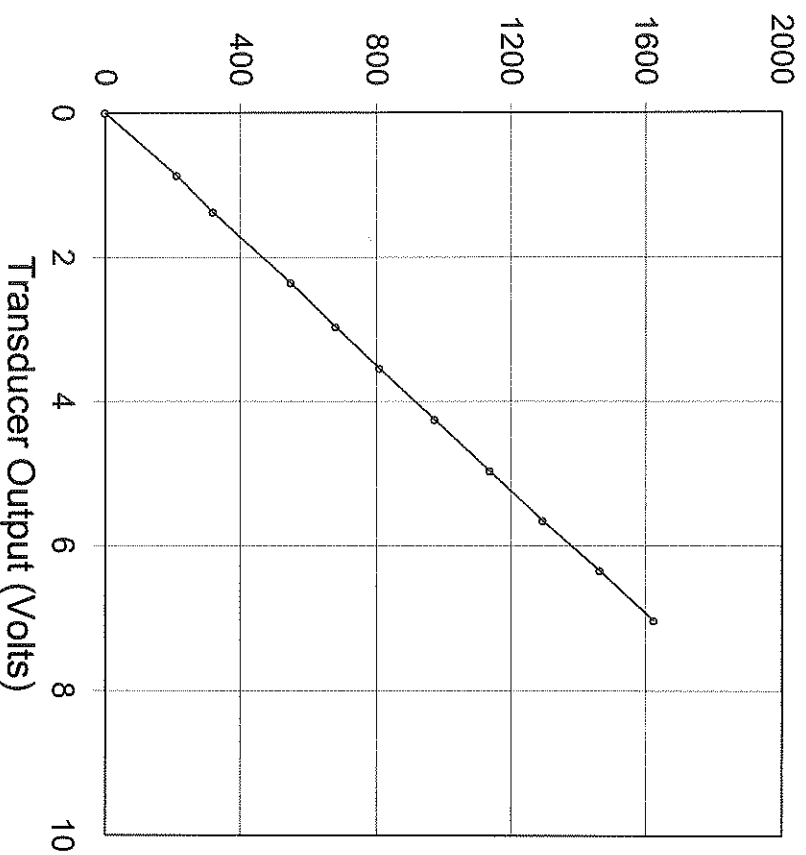

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
213	0.86
320	1.36
547	2.35
679	2.96
809	3.54
973	4.25
1138	4.96
1295	5.65
1464	6.35
1624	7.03

Shunt (60.4 K Ω)

2.5 V

General Factor

398.0 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2004 Version 1.2

Calibrated by: Greg Felt
Calibrated on: 24-Oct-2008