Pile Dynamics, Inc.

Transducer 216I

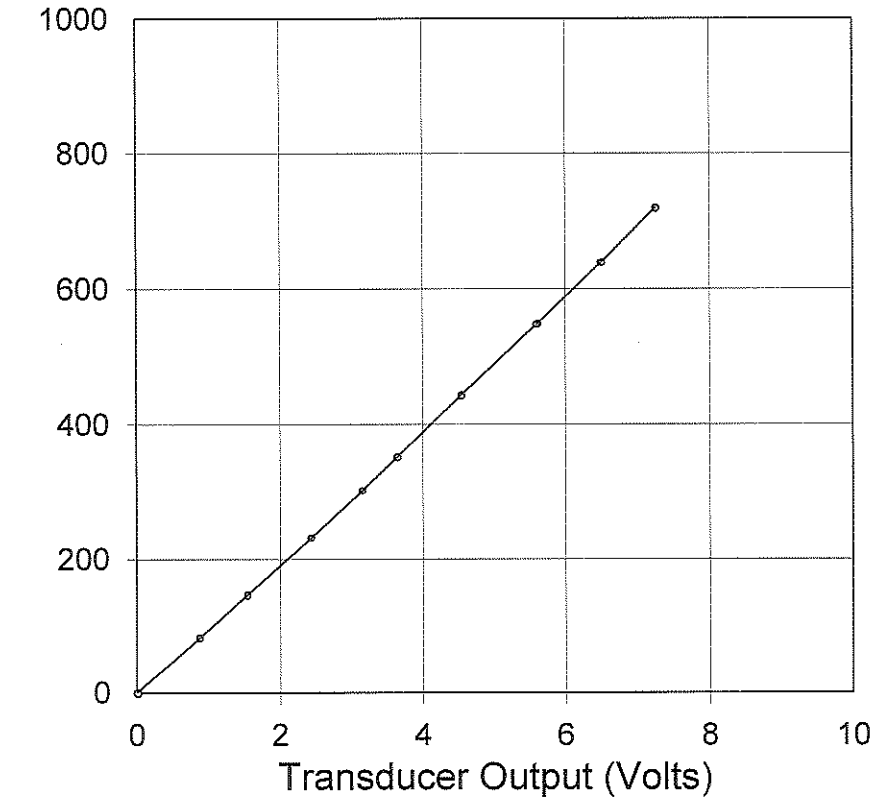

PDA Cal Factor 99.2με/V

Applied Strain (με)	Transducer Output (Volts)
0	0.00
83	0.88
146	1.55
231	2.42
301	3.15
351	3.63
443	4.53
548	5.60
548	5.59
638	6.49
719	7.25

Shunt (60.4 KΩ) 5.0 V

General Factor 344.5με/mV/V

Traceable to N.I.S.T.

Calibrated by: Fred Hamin

Calibrated on: 31-May-2005

Strain Transducer Calibrator System 2004 Version 1.2