Pile Dynamics, Inc.

Transducer 295W

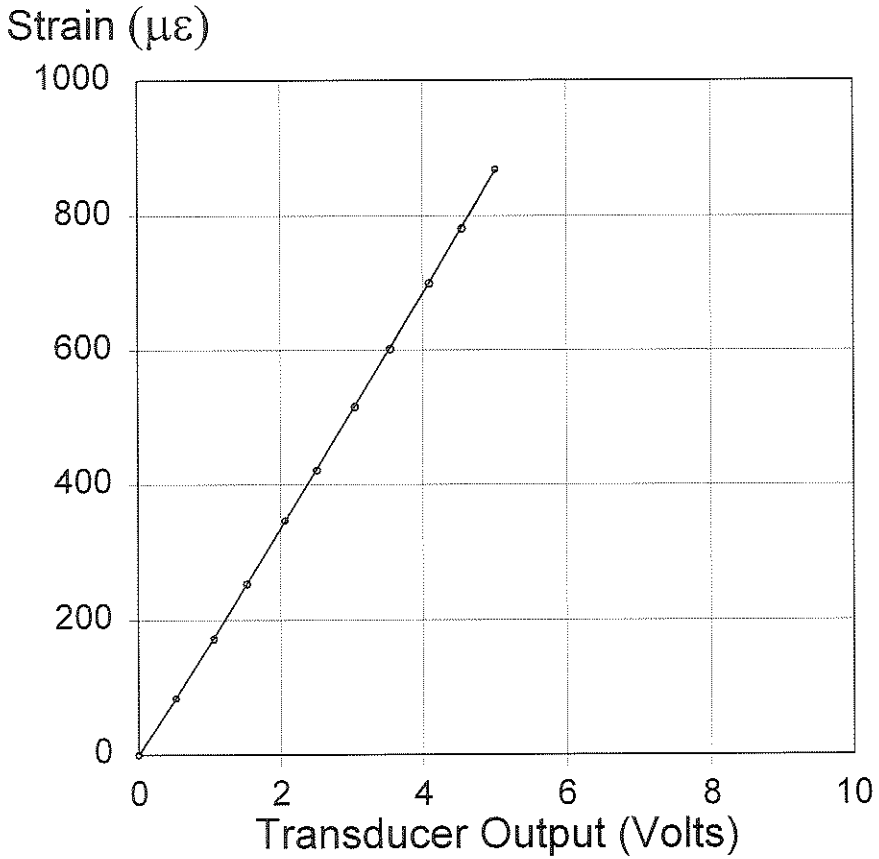

PDA Cal Factor 173.8με/V

Applied Strain (με)	Transducer Output (Volts)
0	0.00
83	0.52
173	1.06
253	1.52
345	2.06
421	2.50
516	3.04
602	3.53
700	4.08
781	4.53
869	5.01

Shunt (60.4 KΩ) 5.0 V

General Factor 603.6με/mV/V

Traceable to N.I.S.T.

Calibrated by: J. Rausche

Calibrated on: 28-Jan-2004

Strain Transducer Calibrator System 2004 Version 1.2