


Pile Dynamics Inc Transducer 299M

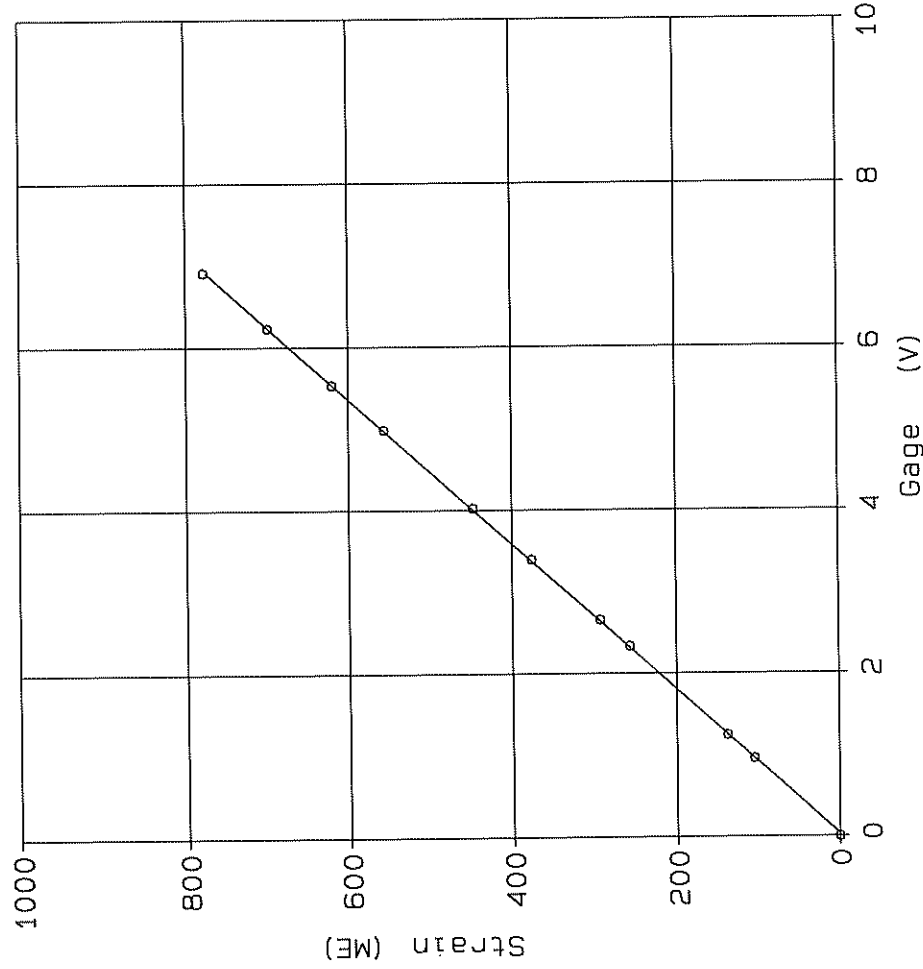

PDA Cal Factor = 112.7 ME/V
 Shunt (60.4KΩ) = 5.0 V
 General Factor = 391.4 ME/mV/V
 Traceable to N.I.S.T.

Strain ME	Gage V
0	.00
106	.97
138	1.26
257	2.33
294	2.66
376	3.39
448	4.02
556	4.98
620	5.53
700	6.23
779	6.91

Calibrated by: *J.D. Dentley*
 Calibrated on: 26-Oct-98