Pile Dynamics, Inc.

Transducer 336W

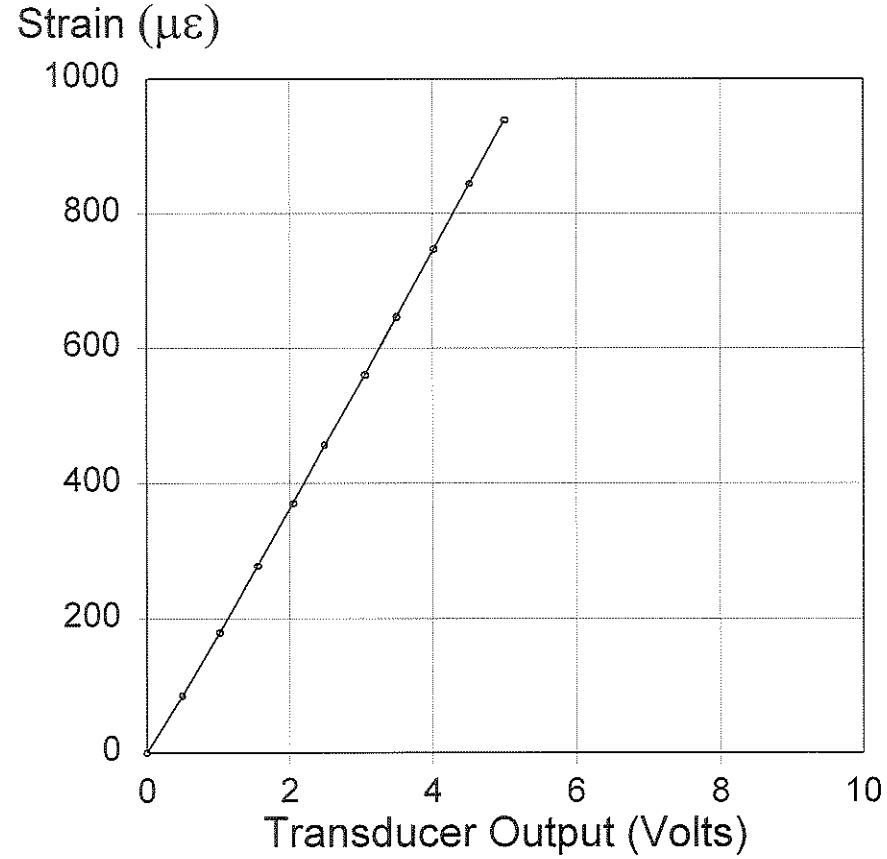

PDA Cal Factor 189.1με/V

Applied Strain (με)	Transducer Output (Volts)
0	0.00
85	0.50
179	1.02
276	1.54
369	2.04
456	2.49
561	3.04
647	3.48
747	4.01
844	4.50
939	4.99

Shunt (60.4 KΩ) 5.0 V

General Factor 656.5με/mV/V

Traceable to N.I.S.T.

Calibrated by: J. Rausche

Calibrated on: 28-Jan-2004

Strain Transducer Calibrator System 2004 Version 1.2