Pile Dynamics, Inc.

Transducer 730W

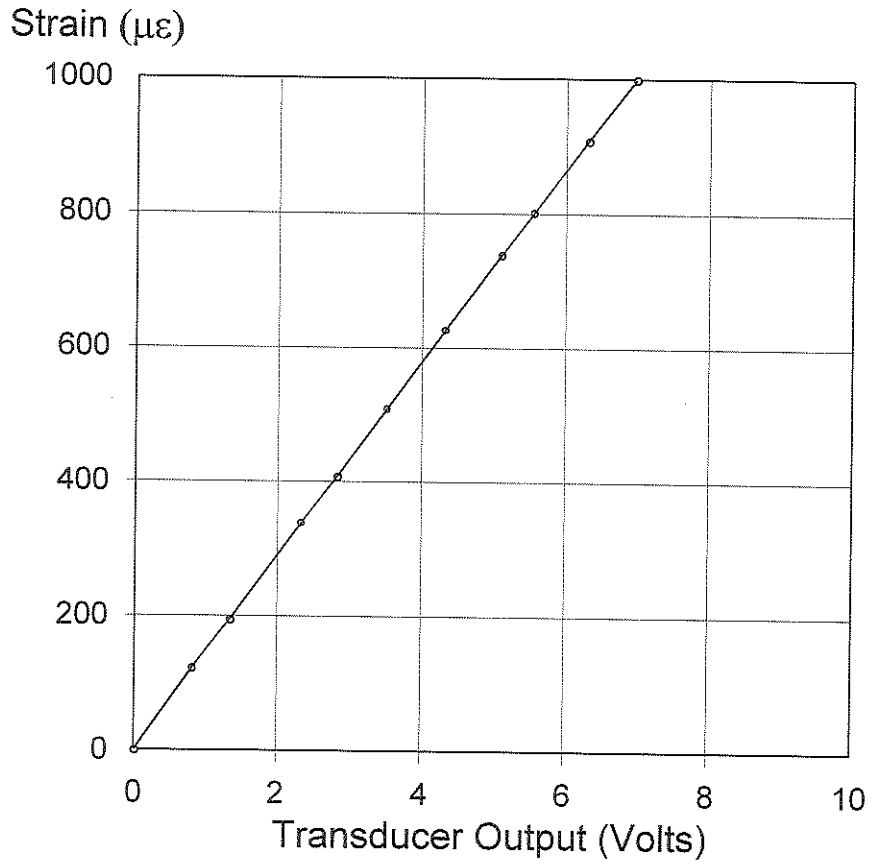

PDA Cal Factor 143.6με/V

Applied Strain (με)	Transducer Output (Volts)
0	0.00
123	0.81
194	1.34
338	2.33
408	2.82
509	3.51
627	4.31
739	5.09
802	5.54
909	6.30
999	6.97

Shunt (60.4 KΩ) 5.0 V

General Factor 498.6με/mV/V

Traceable to N.I.S.T.

Calibrated by: J. Deutsch

Calibrated on: 21-Nov-2004

Strain Transducer Calibrator System 2004 Version 1.2