Pile Dynamics, Inc.

Transducer 743W

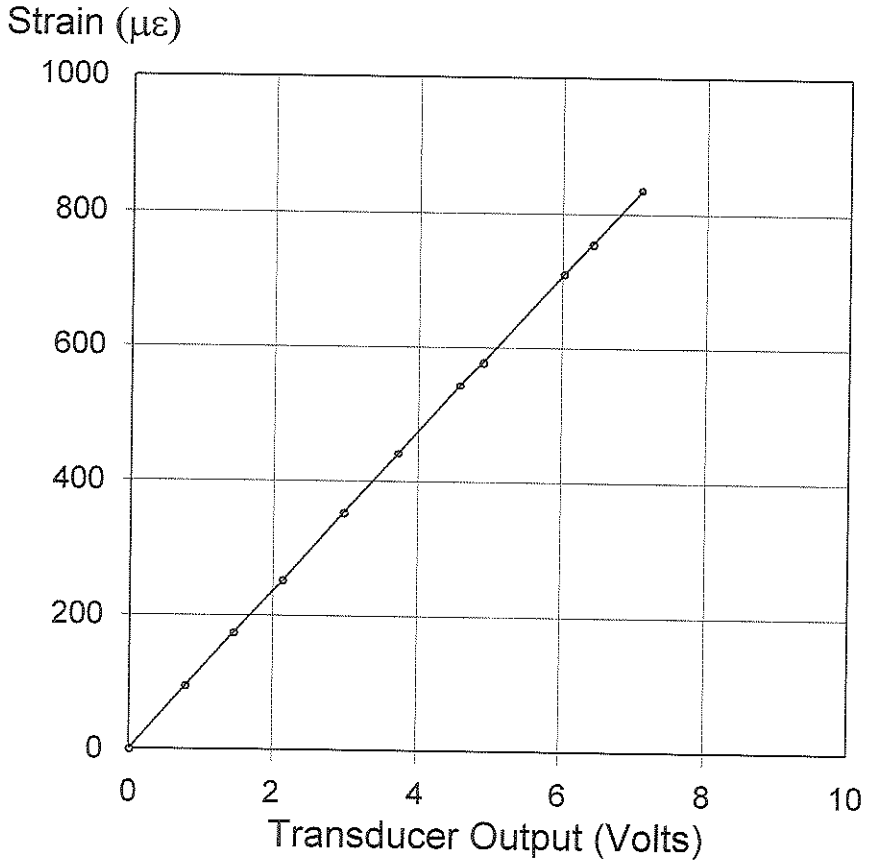

PDA Cal Factor 117.5με/V

Applied Strain (με)	Transducer Output (Volts)
0	0.00
95	0.78
173	1.45
252	2.13
353	2.97
441	3.71
543	4.57
577	4.89
710	6.02
755	6.41
835	7.11

Shunt (60.4 KΩ) 5.0 V

General Factor 407.8με/mV/V

Traceable to N.I.S.T.

Calibrated by: J. Deaton

Calibrated on: 17-Jan-2005

Strain Transducer Calibrator System 2004 Version 1.2