Pile Dynamics, Inc.

Transducer 750W

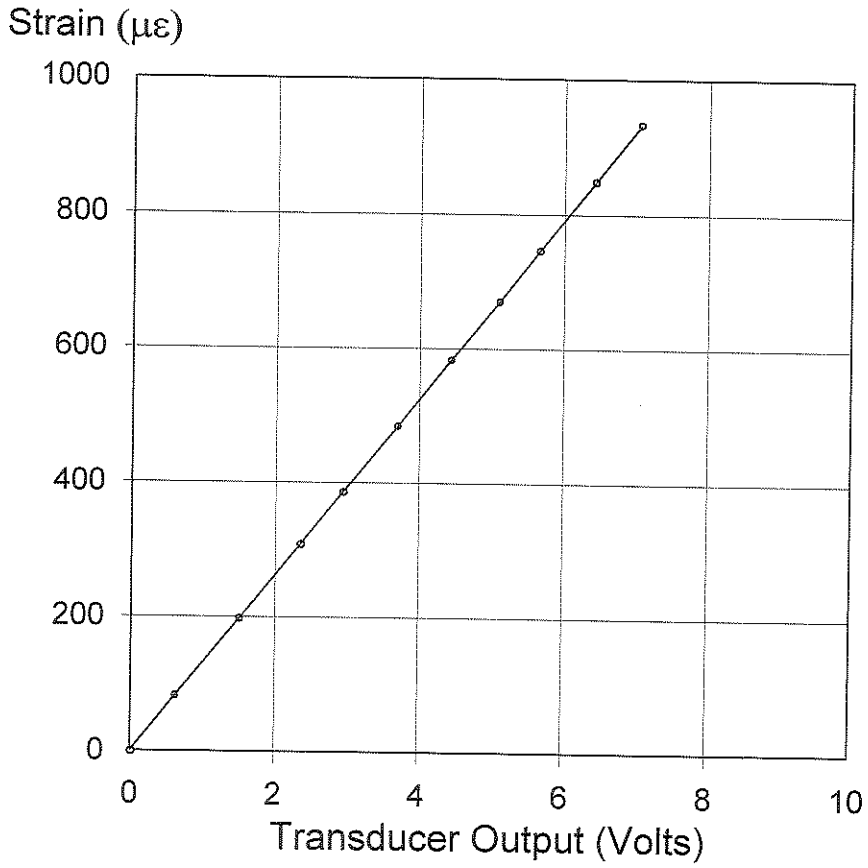

PDA Cal Factor 132.2με/V

Applied Strain (με)	Transducer Output (Volts)
0	0.00
83	0.62
197	1.51
308	2.35
385	2.93
484	3.69
583	4.43
670	5.10
746	5.65
849	6.42
933	7.05

Shunt (60.4 KΩ) 5.0 V

General Factor 459.0με/mV/V

Traceable to N.I.S.T.

Calibrated by: J. Tarbell

Calibrated on: 23-Dec-2004

Strain Transducer Calibrator System 2004 Version 1.2