Pile Dynamics, Inc.

Transducer 752W

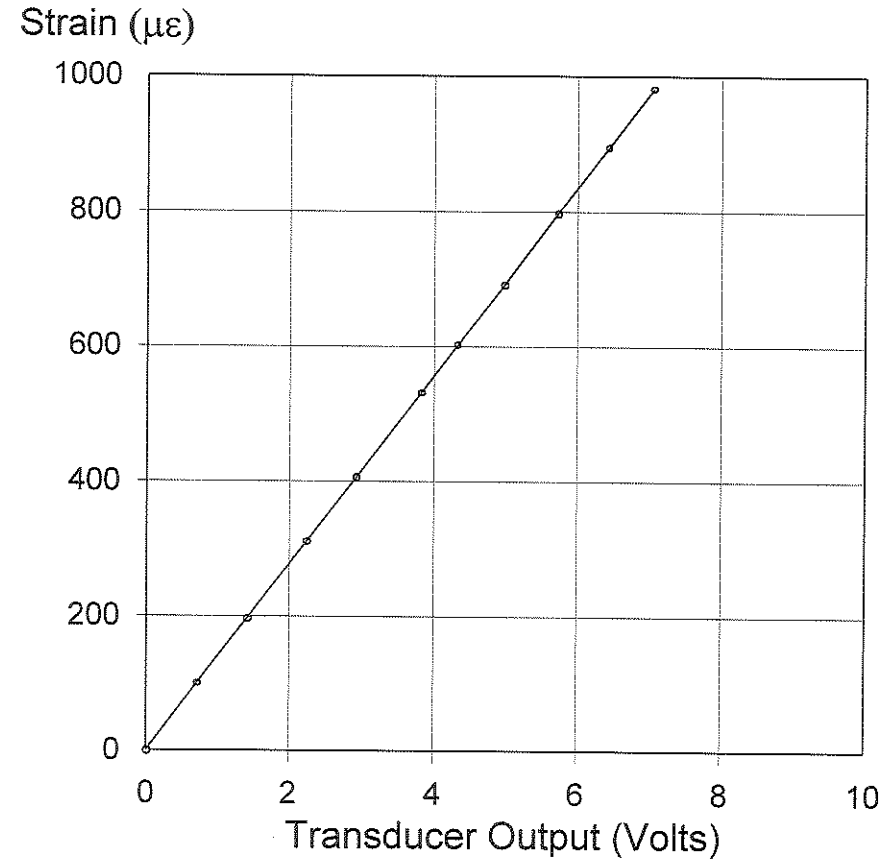

PDA Cal Factor 139.3με/V

Applied Strain (με)	Transducer Output (Volts)
0	0.00
100	0.71
196	1.41
310	2.23
407	2.93
530	3.82
602	4.32
691	4.97
798	5.72
896	6.43
983	7.05

Shunt (60.4 KΩ) 5.0 V

General Factor 483.6με/mV/V

Traceable to N.I.S.T.

Calibrated by: J. Pantaff

Calibrated on: 22-Dec-2004

Strain Transducer Calibrator System 2004 Version 1.2