Pile Dynamics, Inc.

Transducer 754W

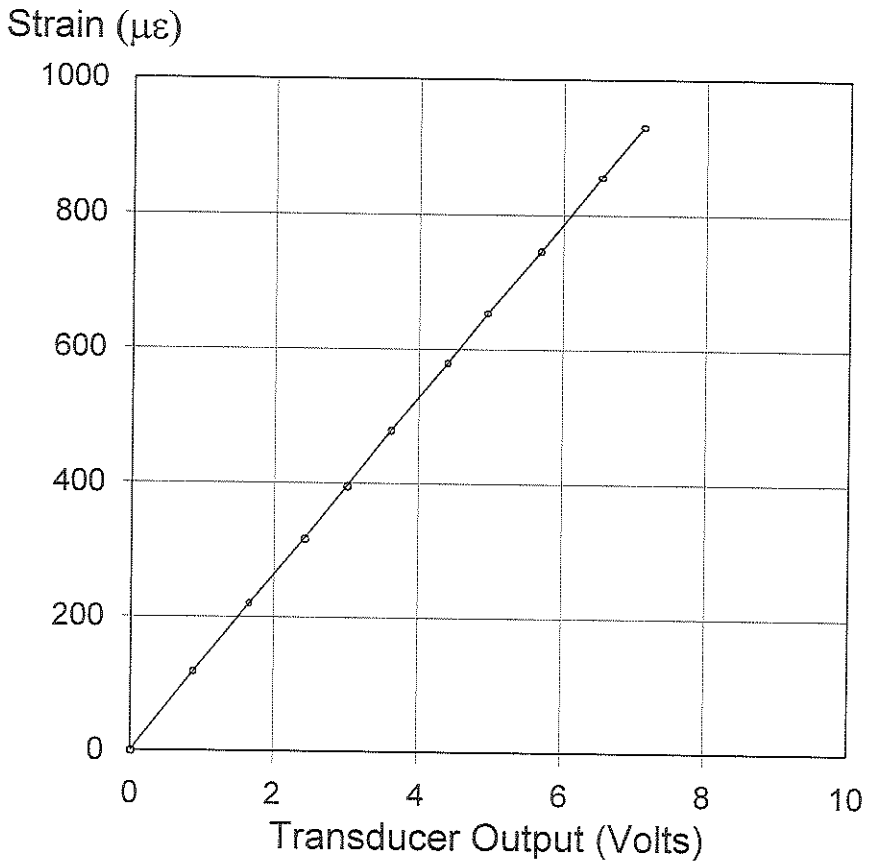

PDA Cal Factor 130.8με/V

Applied Strain (με)	Transducer Output (Volts)
0	0.00
118	0.87
220	1.65
316	2.41
395	3.00
478	3.61
579	4.40
653	4.94
746	5.68
855	6.53
930	7.11

Shunt (60.4 KΩ) 5.0 V

General Factor 454.2με/mV/V

Traceable to N.I.S.T.

Calibrated by: J. Deutsch

Calibrated on: 21-Nov-2004

Strain Transducer Calibrator System 2004 Version 1.2