Pile Dynamics, Inc.

Transducer 762W

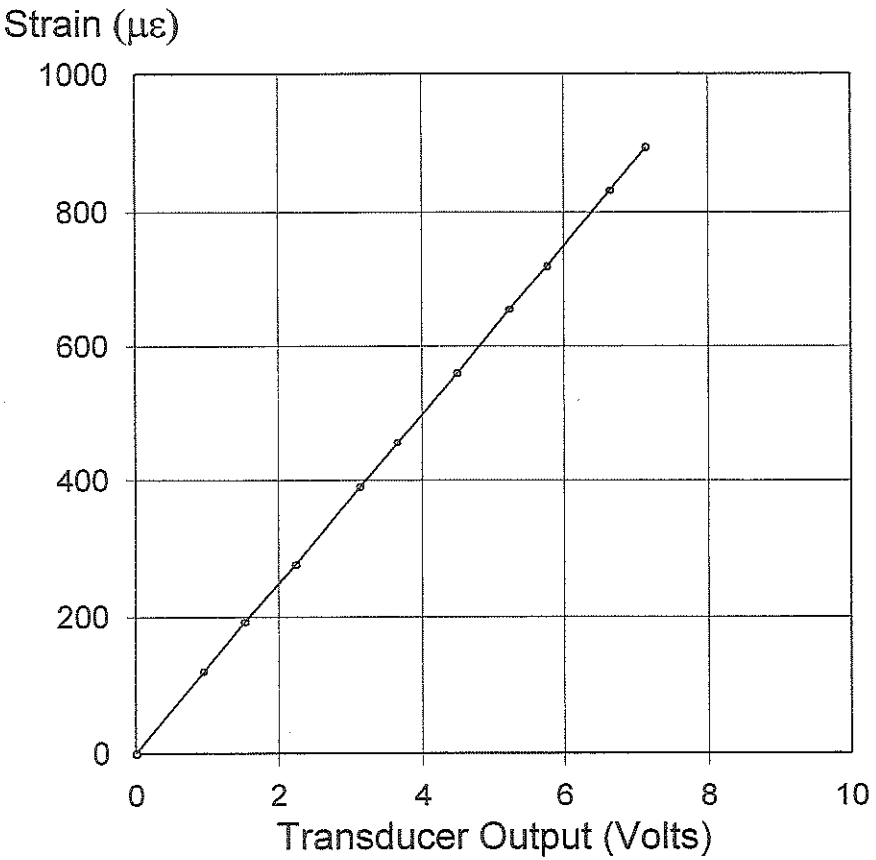

PDA Cal Factor 125.1με/V

Applied Strain (με)	Transducer Output (Volts)
0	0.00
121	0.95
192	1.52
275	2.23
390	3.12
457	3.65
560	4.50
654	5.23
719	5.76
832	6.63
895	7.15

Shunt (60.4 KΩ) 5.0 V

General Factor 434.4με/mV/V

Traceable to N.I.S.T.

Calibrated by: J. Davis

Calibrated on: 19-Jan-2005

Strain Transducer Calibrator System 2004 Version 1.2