Pile Dynamics, Inc.

Transducer 764W

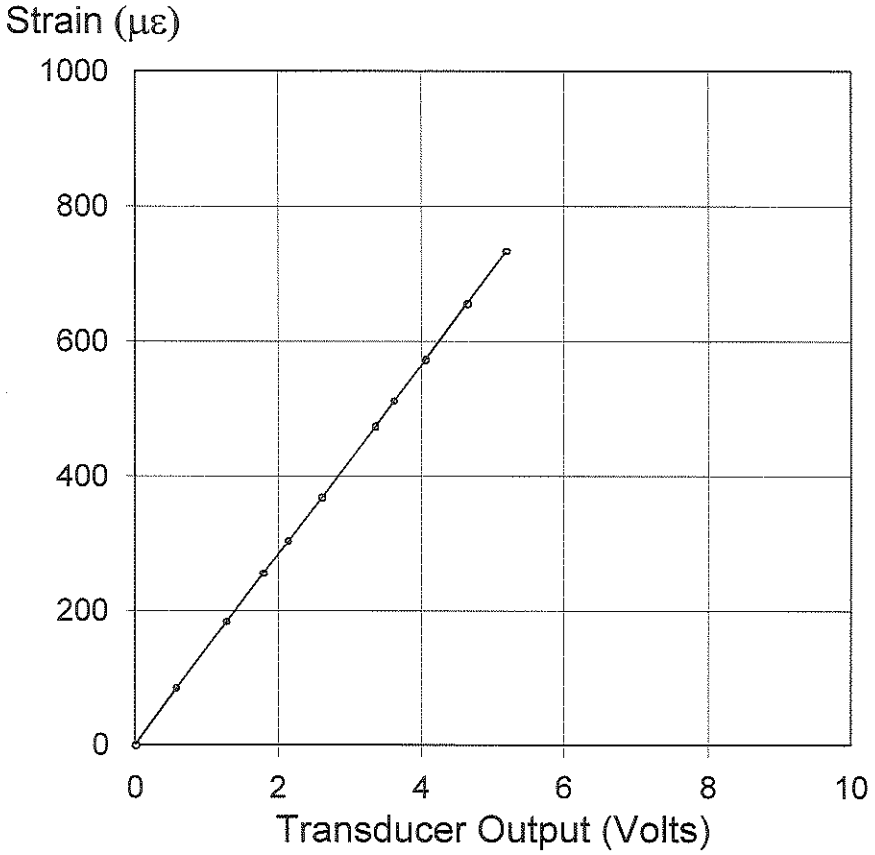

PDA Cal Factor 140.9με/V

Applied Strain (με)	Transducer Output (Volts)
0	0.00
86	0.58
183	1.28
255	1.78
304	2.14
369	2.61
474	3.36
511	3.61
573	4.06
656	4.64
733	5.19

Shunt (60.4 KΩ) 5.0 V

General Factor 489.2με/mV/V

Traceable to N.I.S.T.

Calibrated by: Fred Hamm

Calibrated on: 27-Jun-2005

Strain Transducer Calibrator System 2004 Version 1.2