Pile Dynamics, Inc.

Transducer 769W

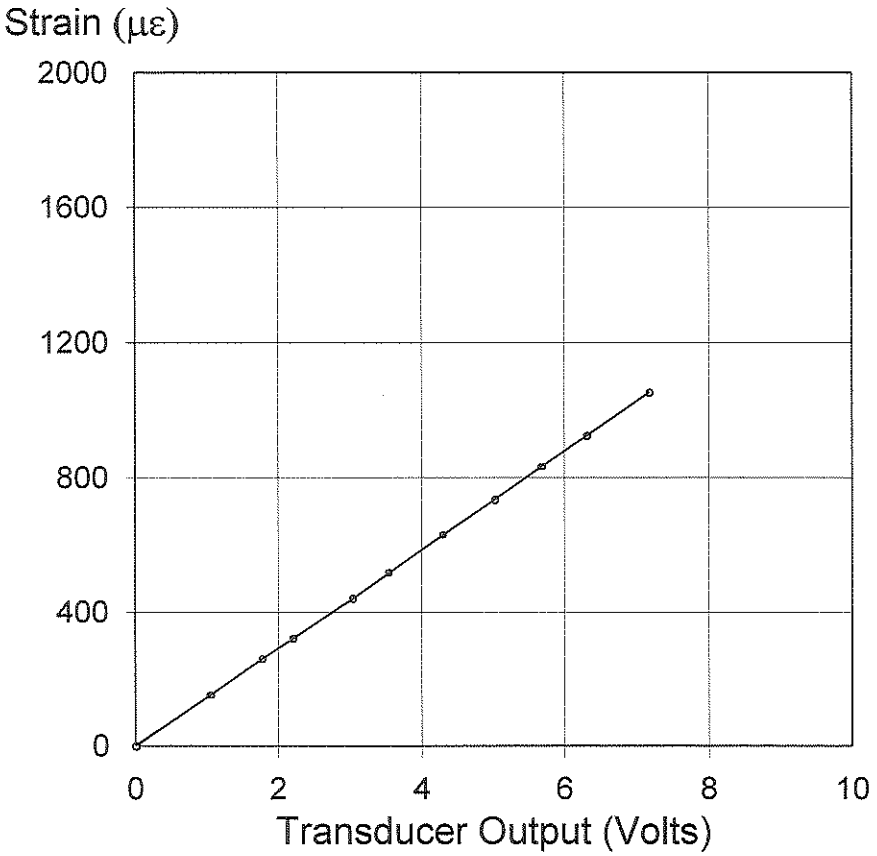

PDA Cal Factor 146.6με/V

Applied Strain (με)	Transducer Output (Volts)
0	0.00
153	1.04
260	1.78
321	2.20
441	3.03
516	3.54
628	4.29
735	5.02
832	5.67
924	6.31
1054	7.19

Shunt (60.4 KΩ) 5.0 V

General Factor 509.0με/mV/V

Traceable to N.I.S.T.

Calibrated by: Fred Hamin

Calibrated on: 27-Jun-2005

Strain Transducer Calibrator System 2004 Version 1.2