Pile Dynamics, Inc.

Transducer 490

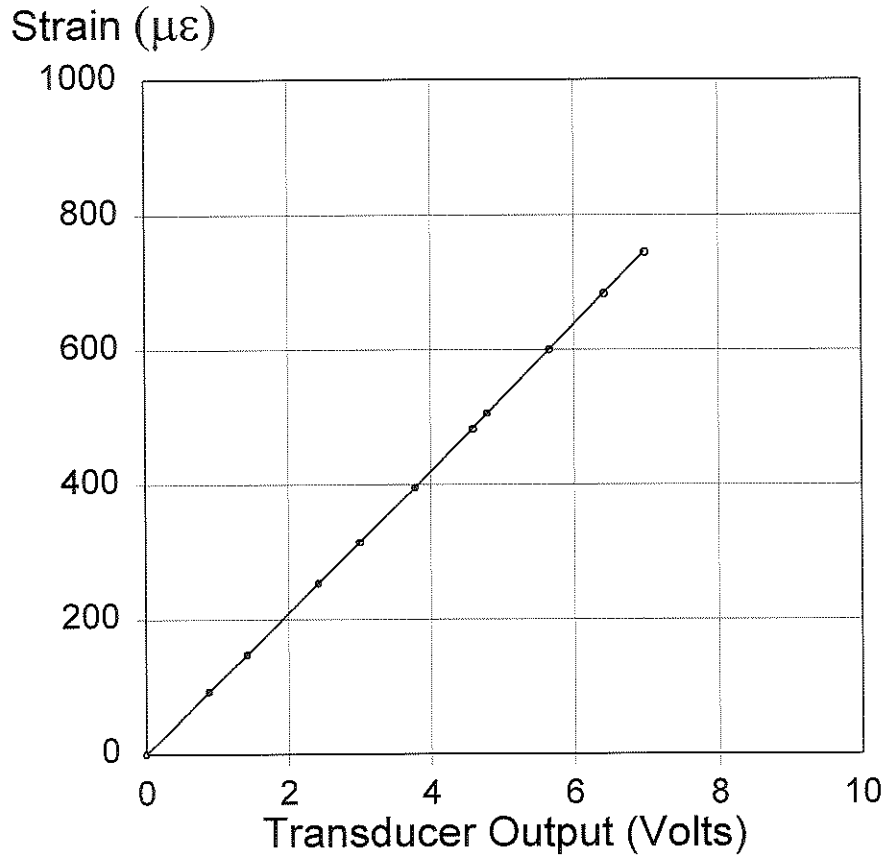

PDA Cal Factor 106.7με/V

Applied Strain (με)	Transducer Output (Volts)
0	0.00
93	0.89
148	1.42
253	2.42
313	2.99
395	3.77
482	4.57
505	4.78
600	5.65
683	6.42
745	6.98

Shunt (60.4 KΩ) 5.0 V

General Factor 370.6με/mV/V

Traceable to N.I.S.T.

Calibrated by: J. Rantall

Calibrated on: 26-Mar-2004

Strain Transducer Calibrator System 2004 Version 1.2