Pile Dynamics, Inc.

Transducer 493

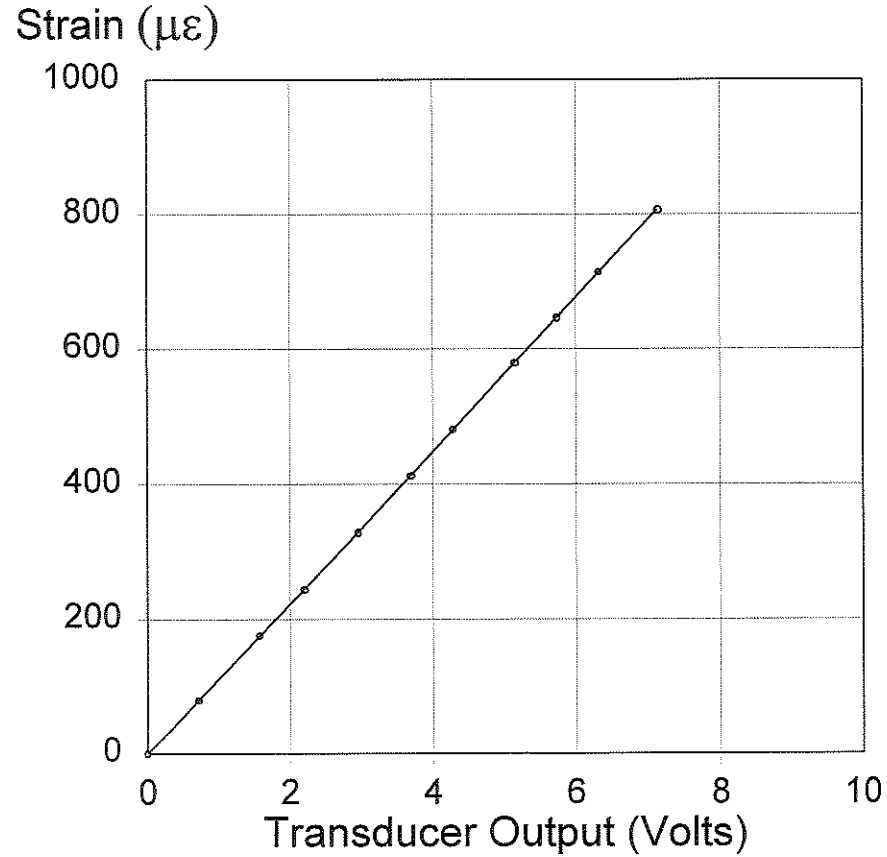

PDA Cal Factor 113.2με/V

Applied Strain (με)	Transducer Output (Volts)
0	0.00
79	0.71
175	1.57
243	2.19
329	2.95
412	3.69
480	4.28
578	5.14
647	5.74
714	6.32
807	7.13

Shunt (60.4 KΩ) 5.0 V

General Factor 393.0με/mV/V

Traceable to N.I.S.T.

Calibrated by: J. L. Turtoff

Calibrated on: 22-Dec-2003

Strain Transducer Calibrator System 2003 Version 1.1