Pile Dynamics, Inc.

Transducer 515

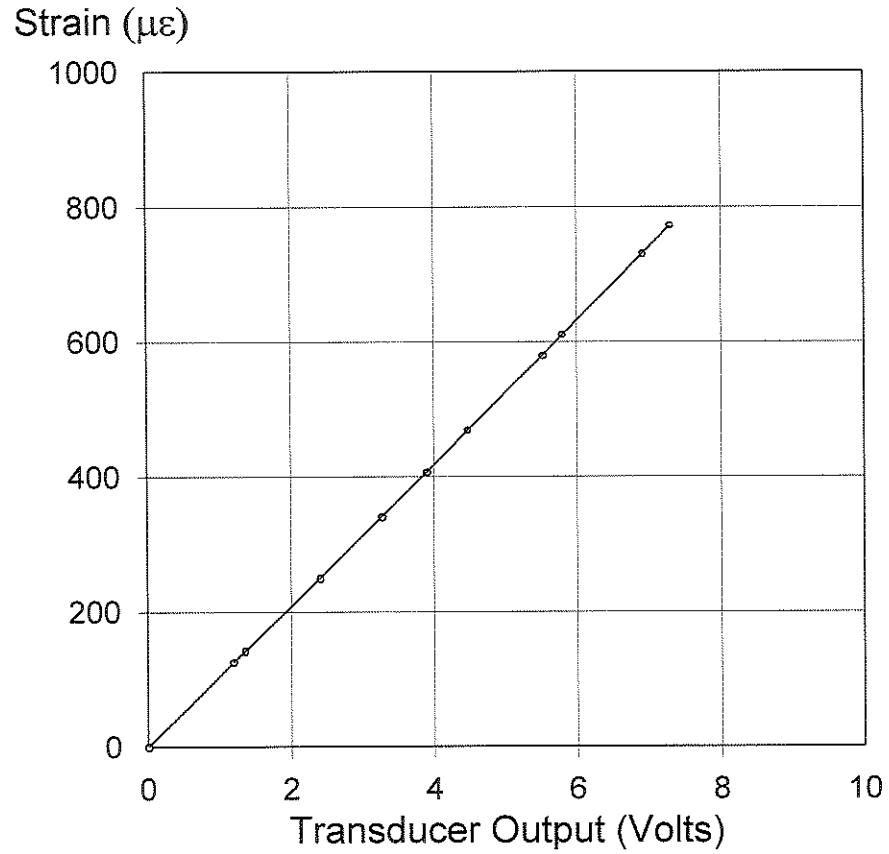

PDA Cal Factor 105.8με/V

Applied Strain (με)	Transducer Output (Volts)
0	0.00
142	1.36
125	1.20
249	2.40
340	3.26
407	3.89
469	4.48
580	5.51
610	5.80
731	6.92
772	7.30

Shunt (60.4 KΩ) 5.0 V

General Factor 367.4με/mV/V

Traceable to N.I.S.T.

Calibrated by: Fred Hussein

Calibrated on: 06-Jan-2005

Strain Transducer Calibrator System 2004 Version 1.2