


Pile Dynamics Inc Transducer 575H

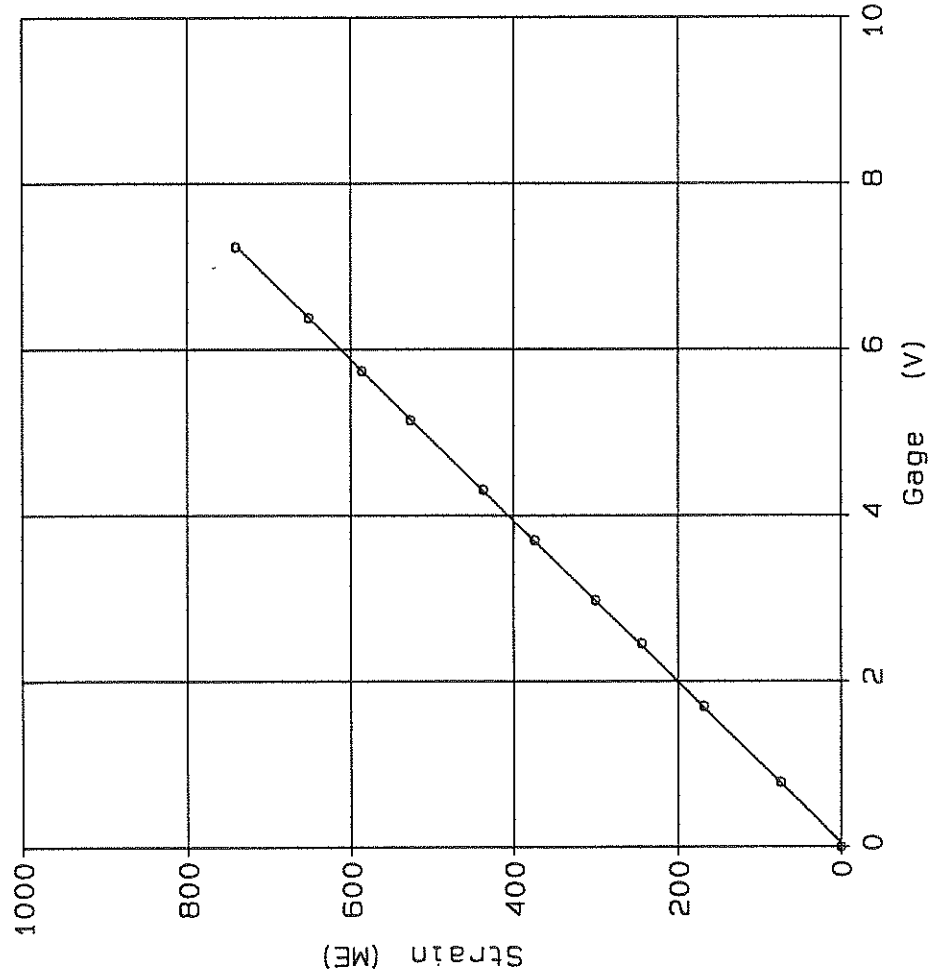

PDA Cal Factor = 103.0 ME/V
 Shunt (60.4KΩ) = 5.0 V
 General Factor = 357.7 ME/mV/V
 Traceable to N.I.S.T.

Strain ME	Gage V
0	.00
74	.79
169	1.71
244	2.45
300	2.98
375	3.70
437	4.31
527	5.16
586	5.75
653	6.38
741	7.23

Calibrated by: J. J. Dantoff
 Calibrated on: 26-Mar-97