




Pile Dynamics, Inc.

Transducer 804H

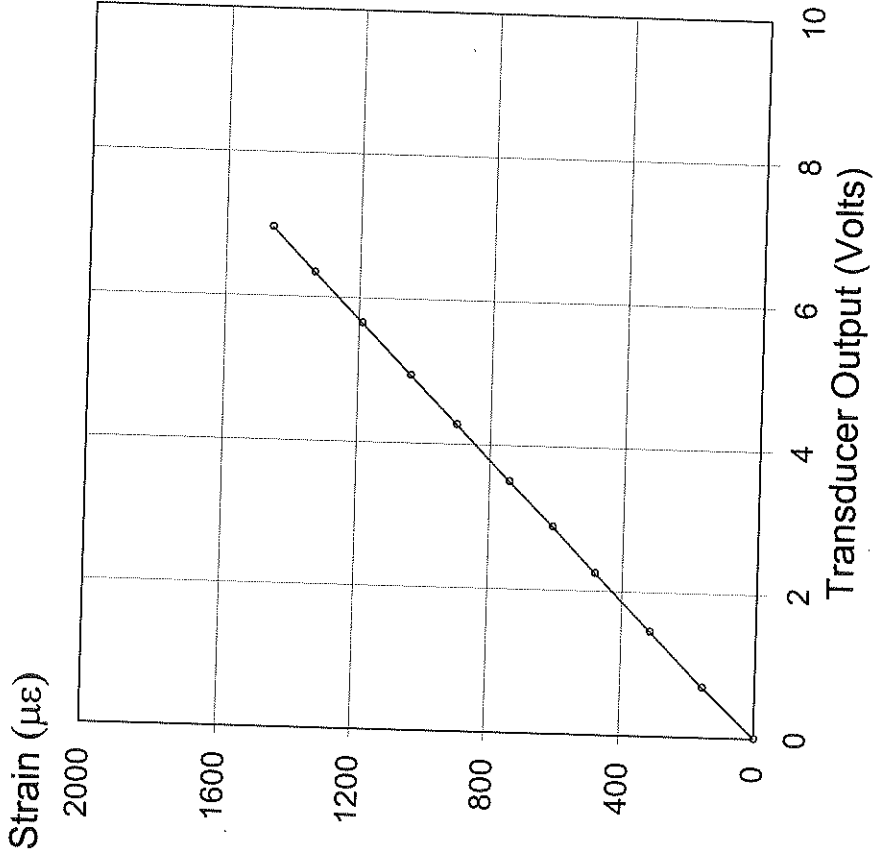

PDA Cal Factor (5.0 V) 104.9 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
157	0.69
315	1.45
481	2.26
609	2.89
741	3.50
903	4.27
1041	4.94
1192	5.65
1338	6.34
1465	6.96

Shunt (60.4 K Ω) 2.5 V
General Factor 364.2 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2004 Version 1.2

Calibrated by: C. P. P.
Calibrated on: 01-Oct-2008