


Pile Dynamics Inc Transducer 808H

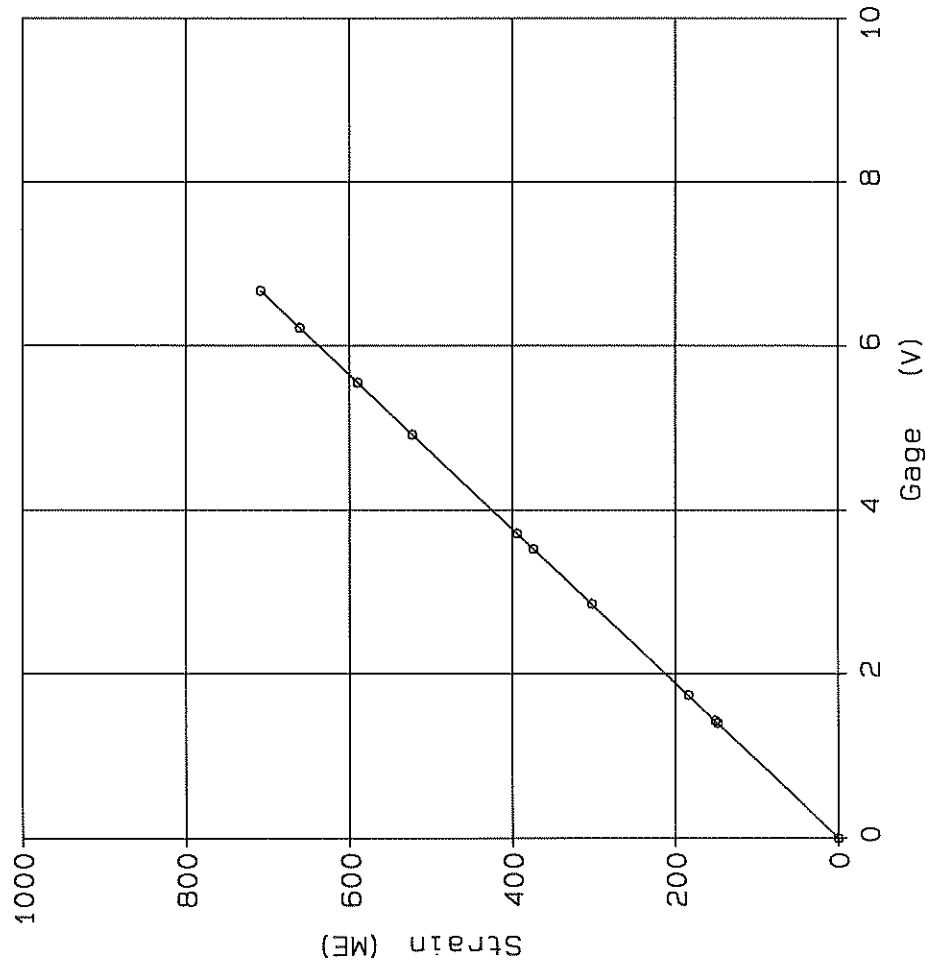

PDA Cal Factor = 106.4 ME/V
 Shunt (60.4KΩ) = 5.0 V
 General Factor = 369.5 ME/mV/V
 Traceable to N.I.S.T.

Strain ME	Gage V
0	.00
151	1.44
149	1.41
184	1.74
303	2.85
374	3.52
394	3.71
523	4.92
591	5.56
661	6.22
710	6.68

Calibrated by: J. P. Bartel
 Calibrated on: 18-Sep-00