




Pile Dynamics, Inc.

# Pile Dynamics, Inc.

## Transducer

## 8098

Strain ( $\mu\epsilon$ )

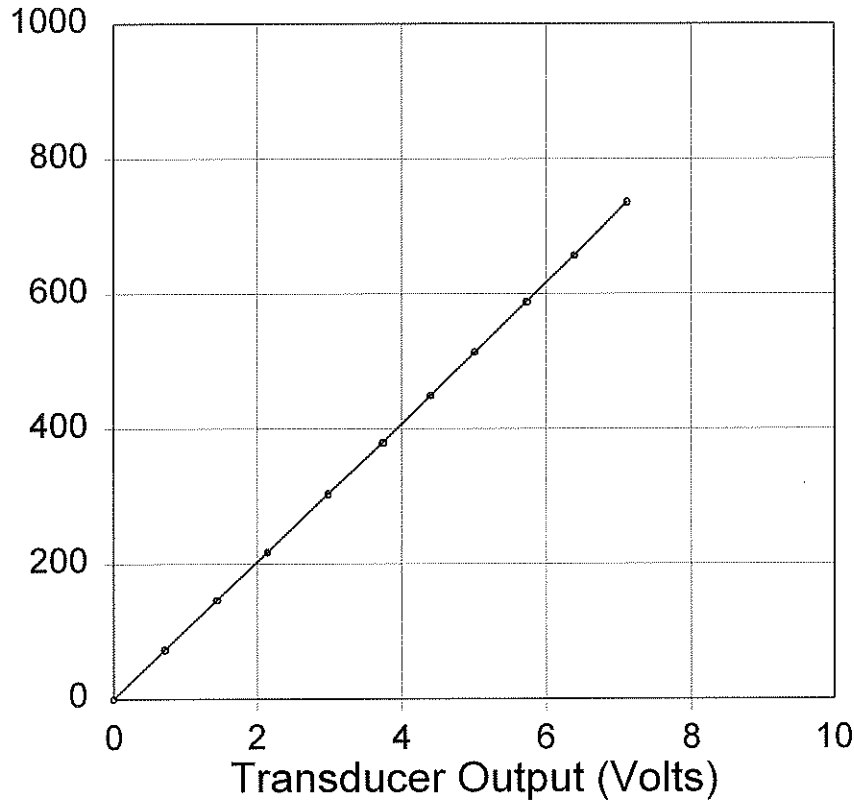

PDA Cal Factor

103.1  $\mu\epsilon/V$

Applied Strain ( $\mu\epsilon$ )	Transducer Output (Volts)
0	0.00
73	0.71
146	1.43
217	2.14
303	2.98
379	3.73
449	4.39
514	5.01
588	5.73
656	6.38
737	7.13

Shunt (60.4 K $\Omega$ )

5.0 V

General Factor

357.8  $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2003 Version 1.1

Calibrated by:

Calibrated on:

29-Dec-2003