




Pile Dynamics, Inc.

Transducer 8123

Strain ($\mu\epsilon$)

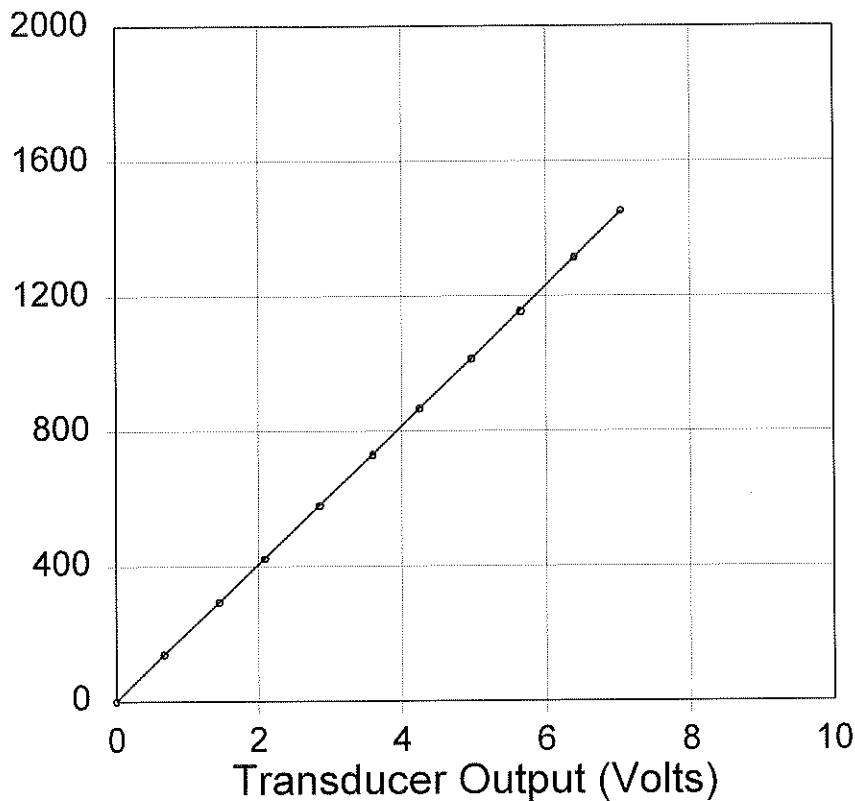

PDA Cal Factor (5.0 V) 102.9 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
139	0.67
292	1.44
422	2.08
580	2.85
731	3.60
867	4.24
1013	4.96
1155	5.64
1315	6.39
1452	7.04

Shunt (60.4 K Ω)

2.5 V

General Factor

357.3 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on:

07-Nov-2006