




Pile Dynamics, Inc.

Pile Dynamics, Inc.

Transducer

8127

Strain ($\mu\epsilon$)

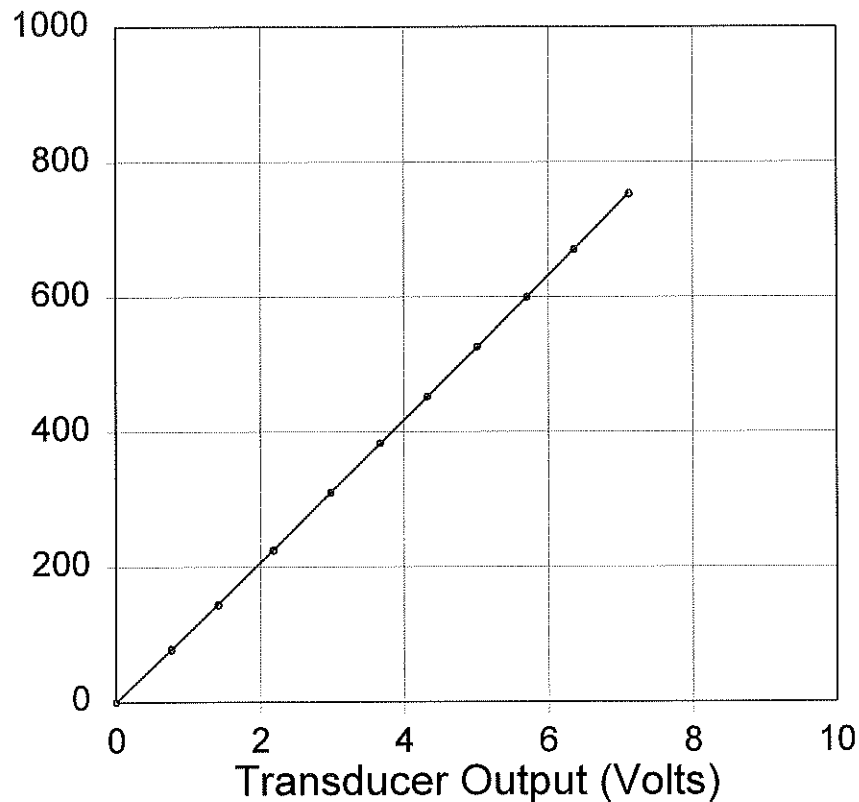

PDA Cal Factor

105.9 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
78	0.76
144	1.40
225	2.17
311	2.98
383	3.67
452	4.32
525	5.01
600	5.70
670	6.35
754	7.11

Shunt (60.4 K Ω)

5.0 V

General Factor

367.9 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2003 Version 1.1

Calibrated by:

Calibrated on:

B. Eason
 05-Jan-2004