


Pile Dynamics Inc Transducer 4029

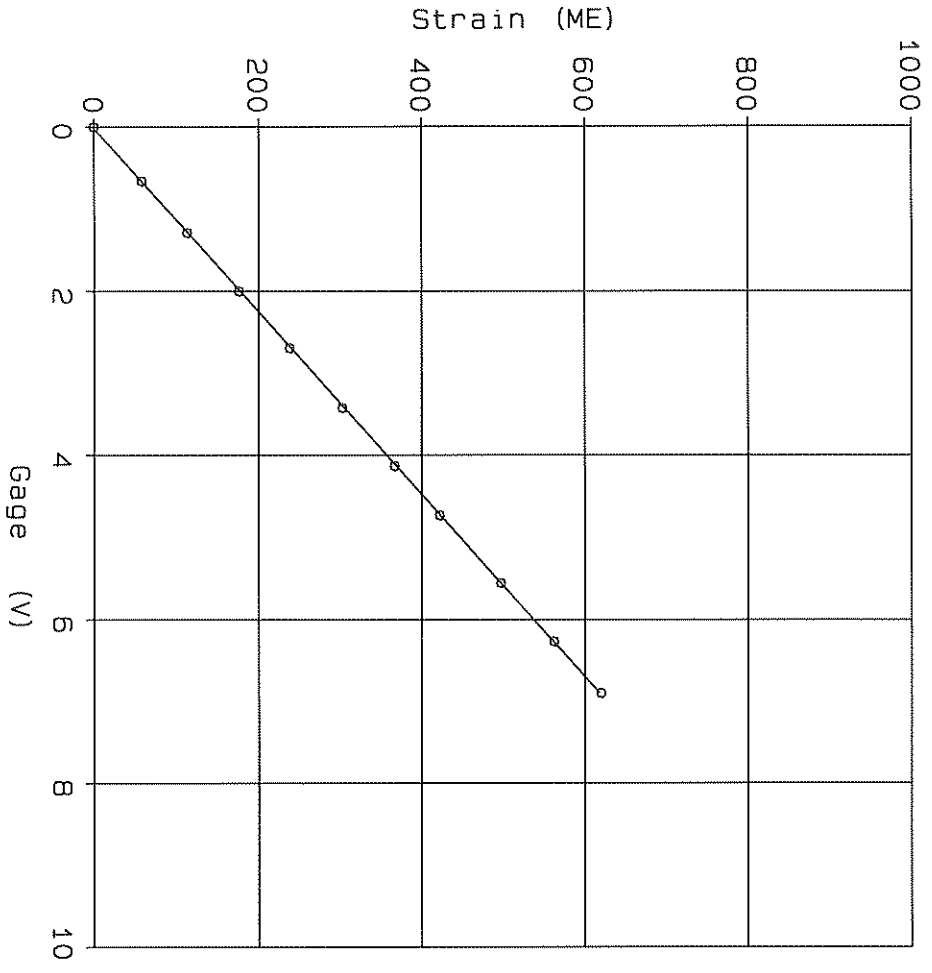

PDA Cal Factor = 89.8 ME/V
 Shunt (60.4K Ω) = 5.0 V
 General Factor = 311.9 ME/mV/V
 Traceable to N.I.S.T.

Strain ME	Gage V
0	.00
58	.66
114	1.29
177	2.00
238	2.69
303	3.42
368	4.13
422	4.74
497	5.56
562	6.27
621	6.91

Calibrated by: *[Signature]*
 Calibrated on: 12-Feb-99