


# Pile Dynamics Inc Transducer 4030

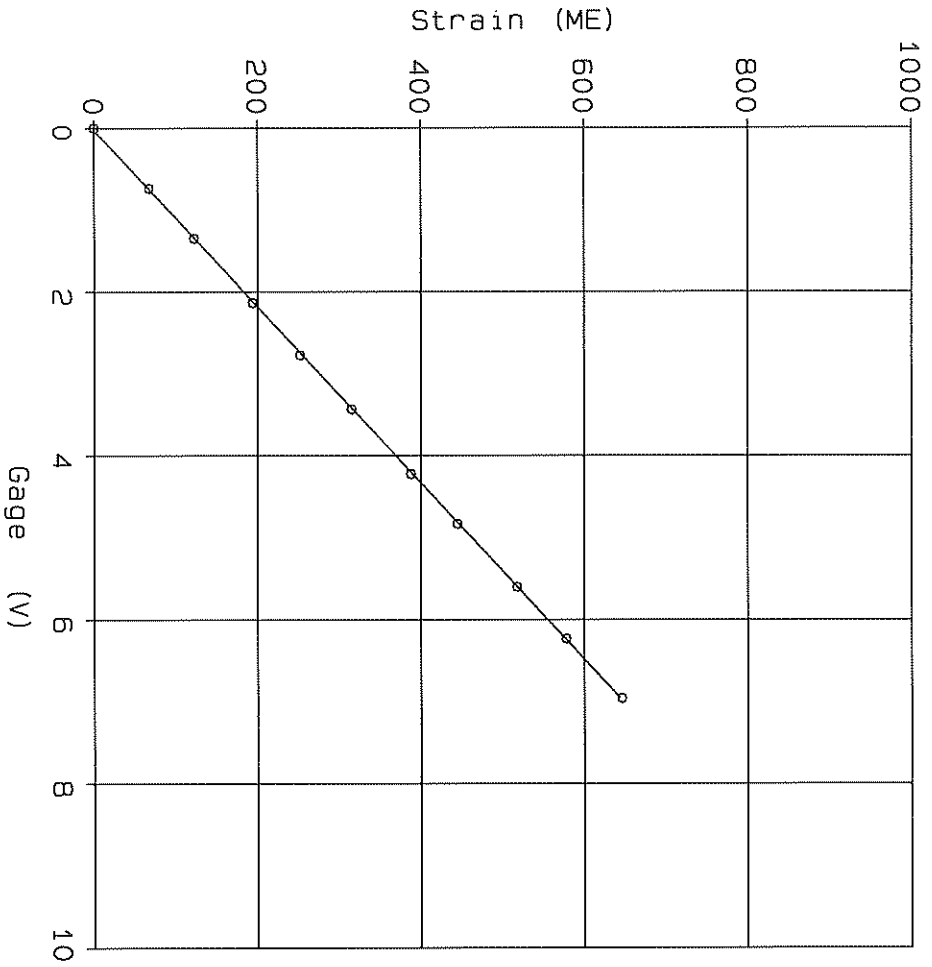

PDA Cal Factor = 93.0 ME/V  
 Shunt (60.4K0) = 5.0 V  
 General Factor = 322.9 ME/mv/V  
 Traceable to N.I.S.T.

Strain ME	Gage V
0	.00
67	.74
123	1.35
194	2.13
253	2.77
315	3.44
388	4.22
445	4.83
518	5.61
579	6.24
647	6.96

Calibrated by: B. Swann  
 Calibrated on: 11-Feb-99