


# Pile Dynamics Inc Transducer 4032

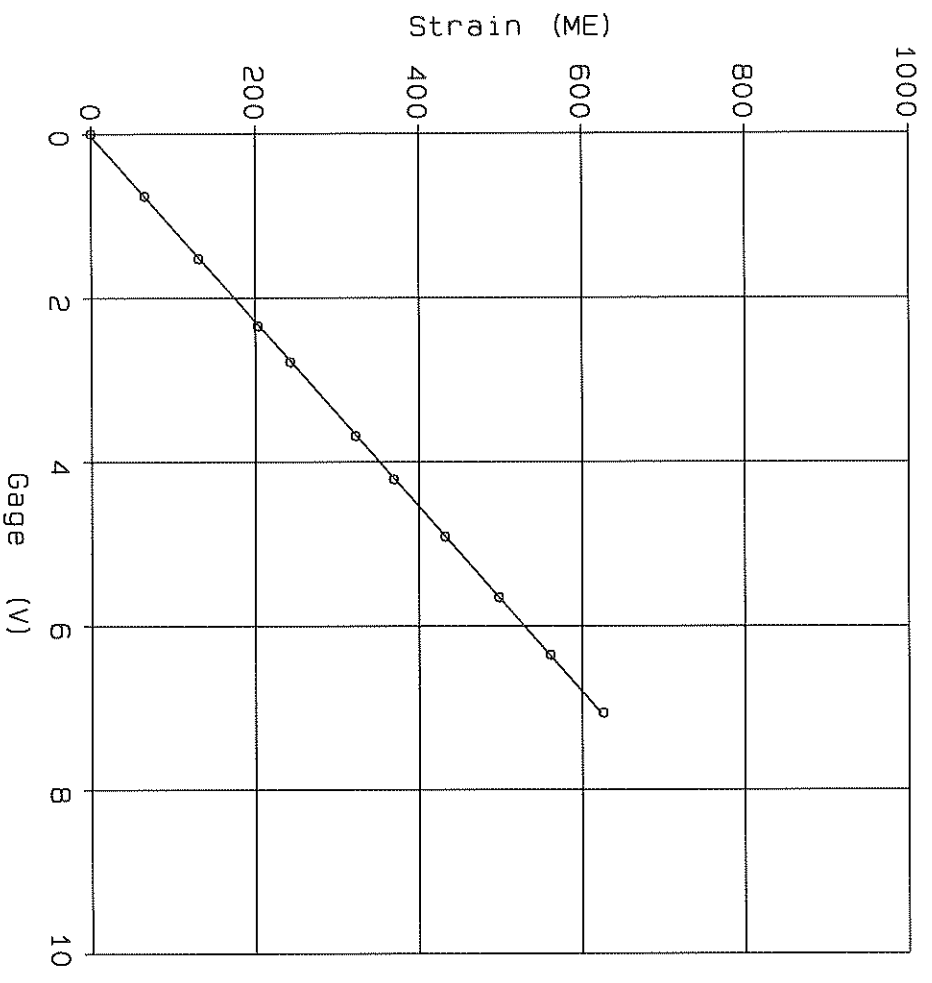

PDA Cal Factor = 88.7 ME/V  
 Shunt (60.4K0) = 5.0 V  
 General Factor = 308.1 ME/mV/V  
 Traceable to N.I.S.T.

Strain ME	Gage V
0	.00
66	.76
132	1.53
204	2.34
243	2.79
323	3.69
370	4.22
433	4.92
498	5.65
562	6.35
627	7.06

Calibrated by: B. Swann  
 Calibrated on: 12-Feb-99