


Pile Dynamics Inc Transducer 4033

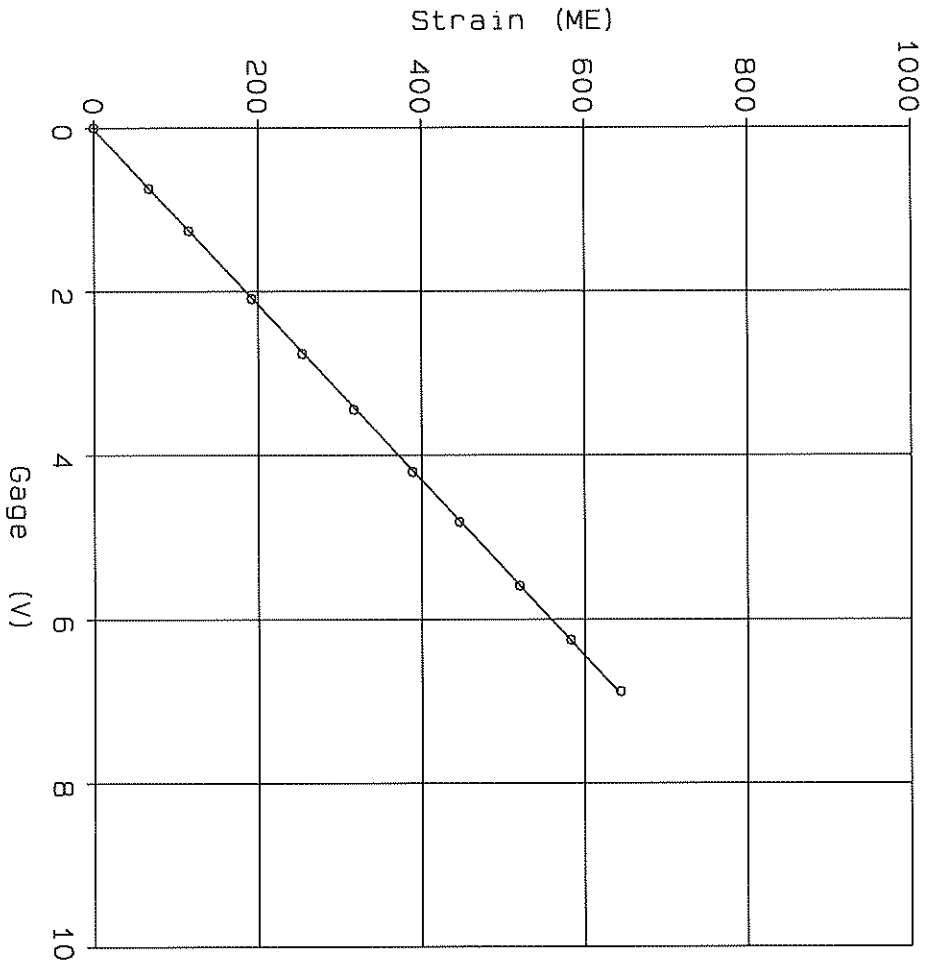

PDA Cal Factor = 93.6 ME/V
 Shunt (60.4K0) = 5.0 V
 General Factor = 324.8 ME/mv/V
 Traceable to N.I.S.T.

Strain ME	Gage V
0	.00
68	.74
116	1.27
192	2.10
254	2.77
318	3.45
389	4.21
447	4.81
520	5.59
584	6.25
644	6.89

Calibrated by: B. Swann
 Calibrated on: 12-Feb-99