




Pile Dynamics, Inc.

# Pile Dynamics, Inc.

## Transducer

## 8957

Strain ( $\mu\epsilon$ )

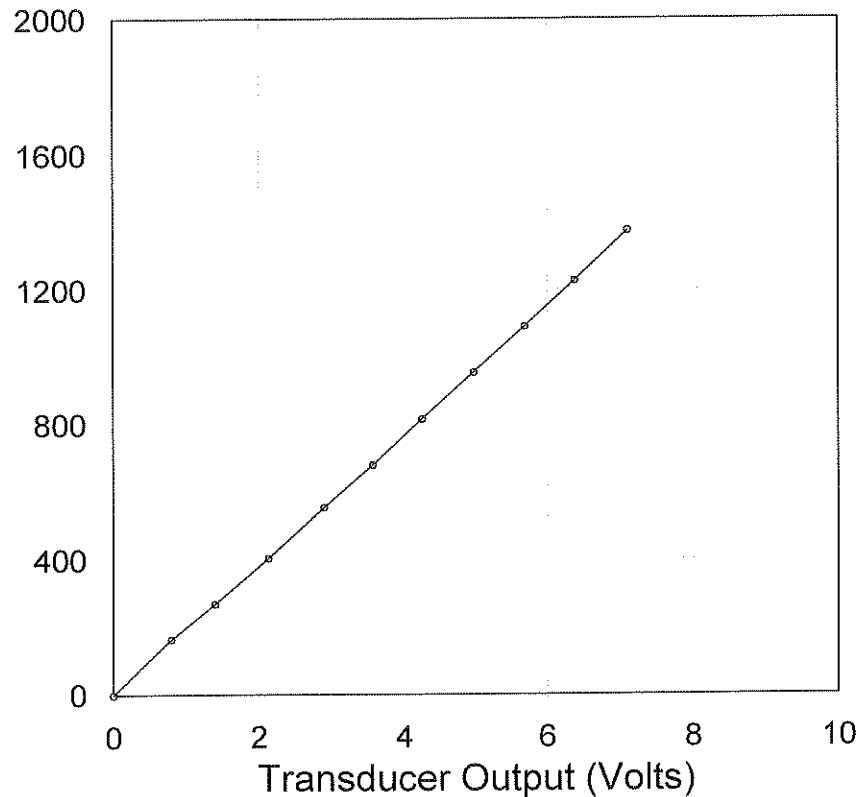

PDA Cal Factor (5.0 V)

96.2 $\mu\epsilon/V$

Applied Strain ( $\mu\epsilon$ )	Transducer Output (Volts)
0	0.00
166	0.80
270	1.40
404	2.13
552	2.89
679	3.56
814	4.25
953	4.97
1091	5.68
1226	6.37
1376	7.10

Shunt (60.4 K $\Omega$ )

2.5 V

General Factor

333.9 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on:

09-Nov-2013