




Pile Dynamics, Inc.

Transducer

9049

Strain ($\mu\epsilon$)

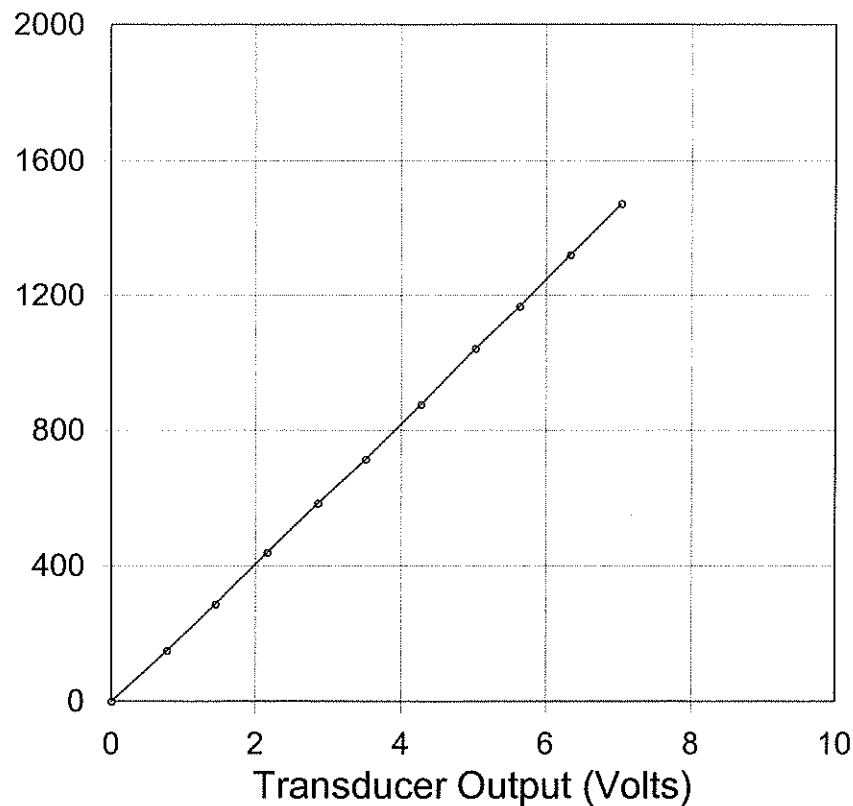

PDA Cal Factor (5.0 V)

105.0 $\mu\epsilon$ /V

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
150	0.77
286	1.43
438	2.16
583	2.86
713	3.51
876	4.27
1042	5.02
1167	5.63
1321	6.33
1474	7.03

Shunt (60.4 K Ω)

2.5 V

General Factor

364.6 $\mu\epsilon$ /mV/V

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2004 Version 1.2

Calibrated by:

George P. ...

Calibrated on:

12-Jul-2007