


Pile Dynamics Inc Transducer 5117

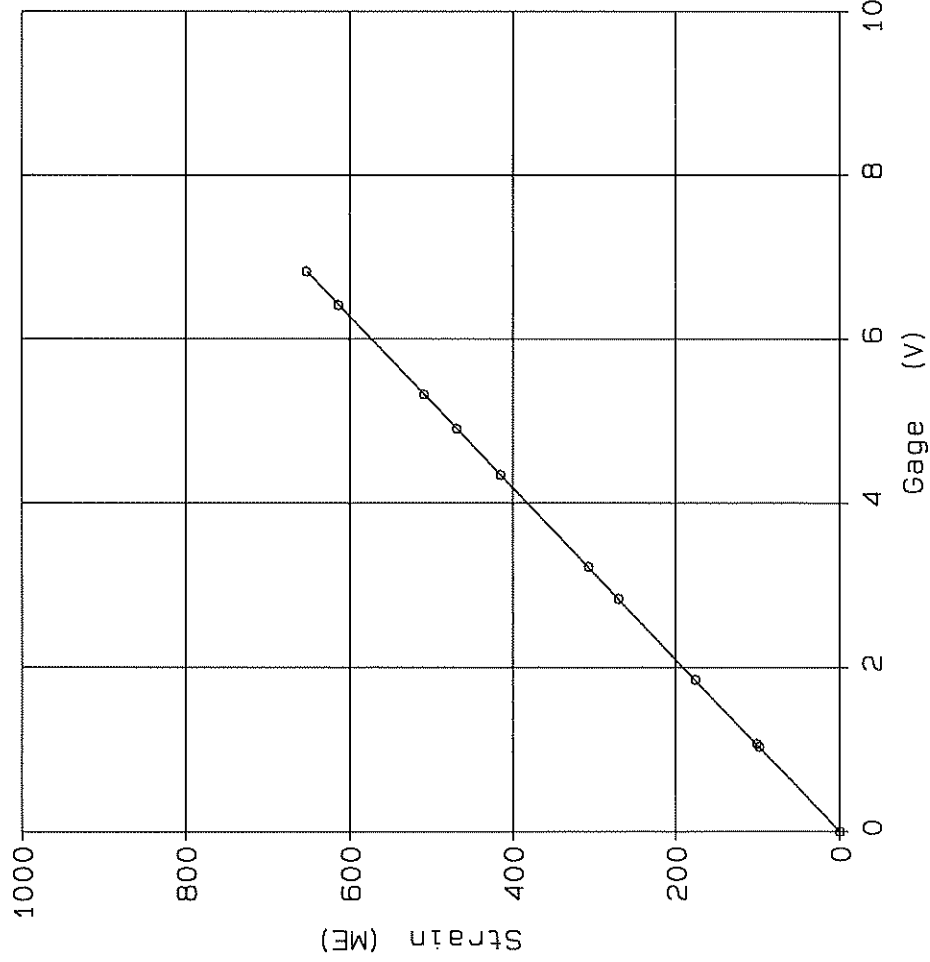

PDA Cal Factor = 95.8 ME/V
 Shunt (60.4K Ω) = 5.0 V
 General Factor = 332.5 ME/mV/V
 Traceable to N.I.S.T.

Strain ME	Gage V
0	.00
99	1.04
102	1.07
176	1.85
271	2.83
307	3.22
415	4.34
469	4.91
510	5.33
614	6.42
653	6.82

Calibrated by: J. Dentell
 Calibrated on: 29-Dec-00