


Pile Dynamics Inc Transducer 5130

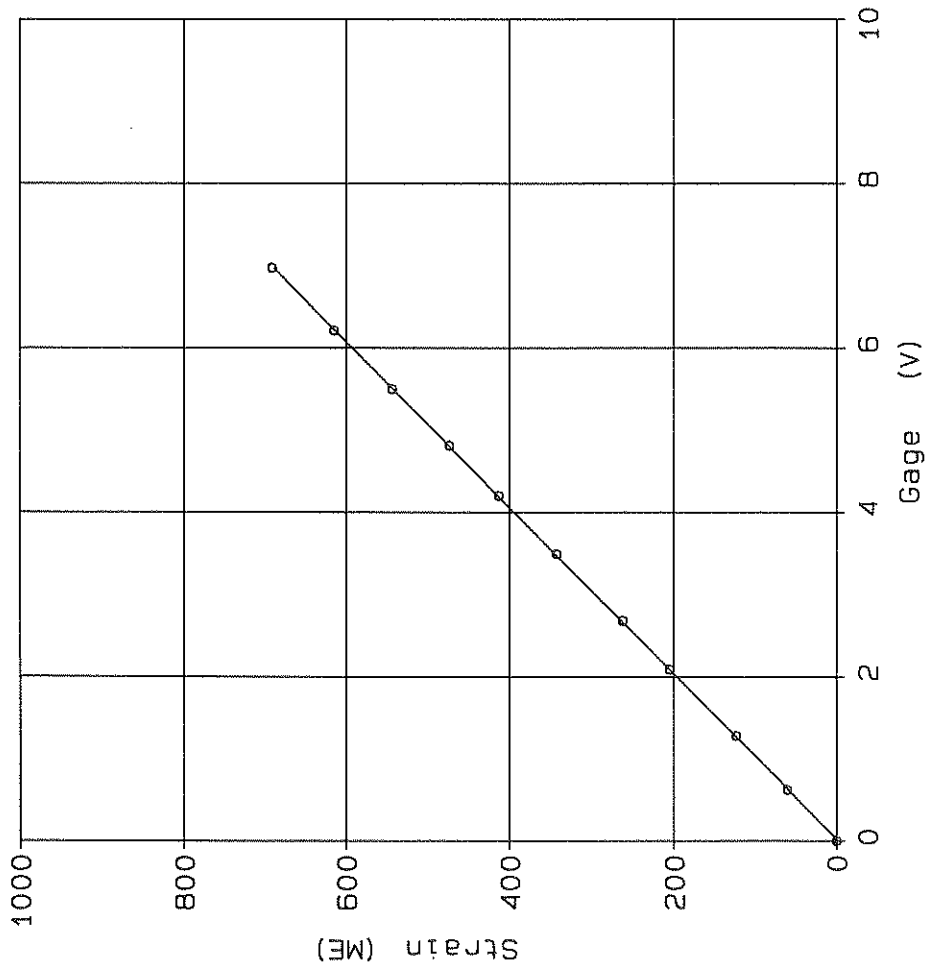

PDA Cal Factor = 99.2 ME/V
 Shunt (60.4KΩ) = 5.0 V

 General Factor = 344.4 ME/mV/V
 Traceable to N.I.S.T.

Strain ME	Gage V
0	.00
61	.63
125	1.29
205	2.10
262	2.68
343	3.49
414	4.20
474	4.81
544	5.51
616	6.22
691	6.98

Calibrated by: *J. J. Dettlaff*

Calibrated on: 26-Mar-03