


# Pile Dynamics Inc Transducer 5165

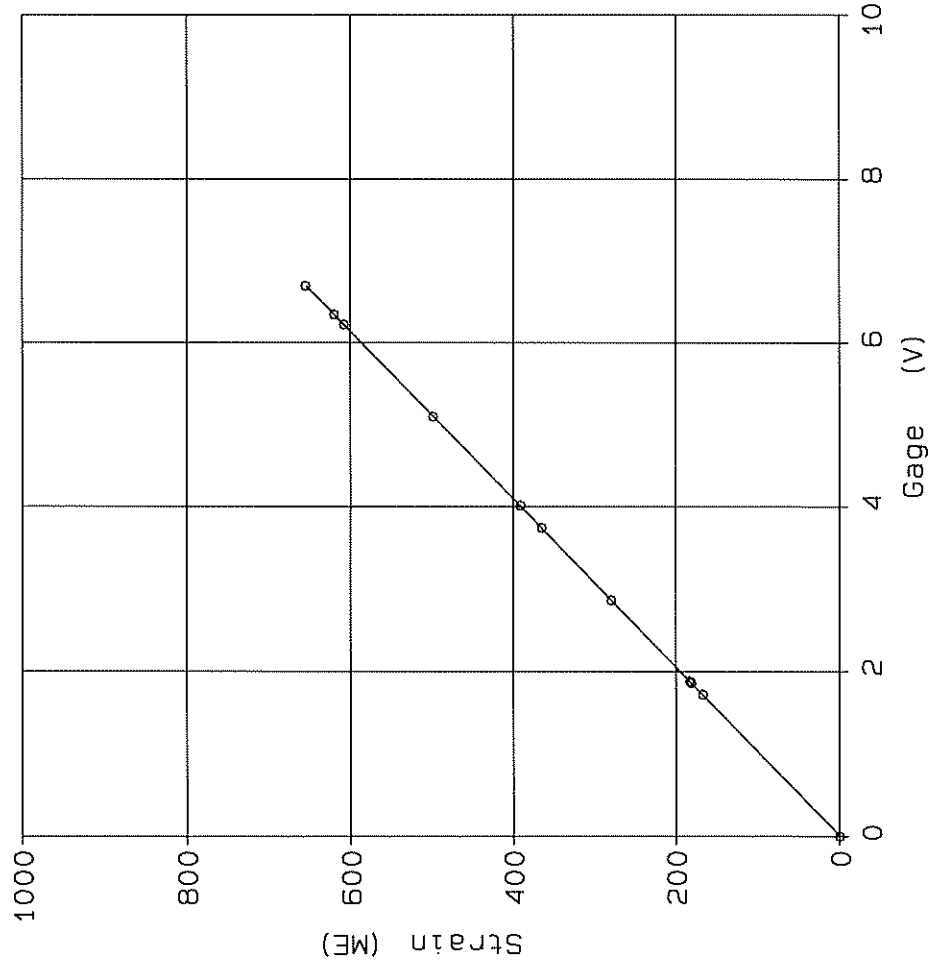

PDA Cal Factor = 98.0 ME/V  
 Shunt (60.4KΩ) = 5.0 V  
 General Factor = 340.3 ME/mV/V  
 Traceable to N.I.S.T.

| Strain<br>ME | Gage<br>V |
|--------------|-----------|
| 0            | .00       |
| 181          | 1.87      |
| 168          | 1.72      |
| 183          | 1.89      |
| 279          | 2.87      |
| 366          | 3.75      |
| 392          | 4.01      |
| 499          | 5.10      |
| 608          | 6.22      |
| 621          | 6.35      |
| 656          | 6.69      |

Calibrated by: *J. J. Bentley*

Calibrated on: 26-Jan-01