


Pile Dynamics Inc Transducer 5166

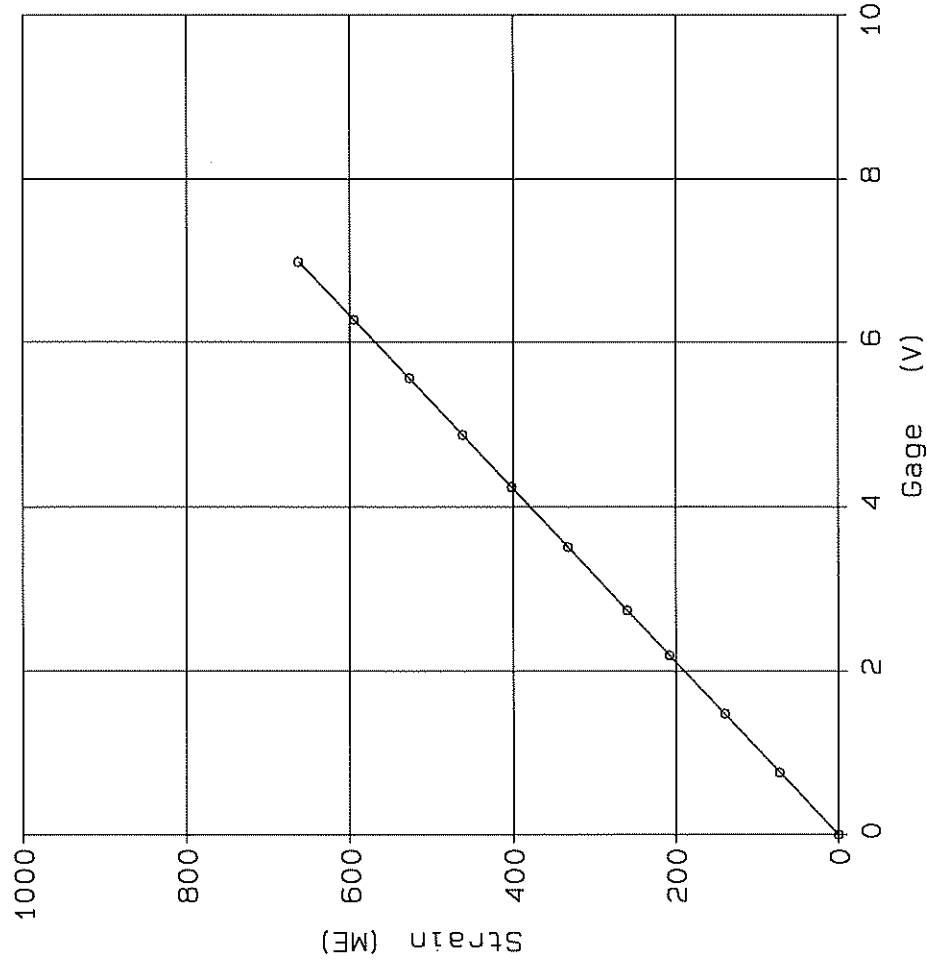

PDA Cal Factor = 94.9 ME/V
 Shunt (60.4KΩ) = 5.0 V
 General Factor = 329.5 ME/mV/V
 Traceable to N.I.S.T.

Strain ME	Gage V
0	.00
73	.77
140	1.48
209	2.20
260	2.75
334	3.52
403	4.25
462	4.87
528	5.57
595	6.27
663	6.99

Calibrated by: Greg Smith
 Calibrated on: 07-Feb-01