


Pile Dynamics Inc Transducer 5170

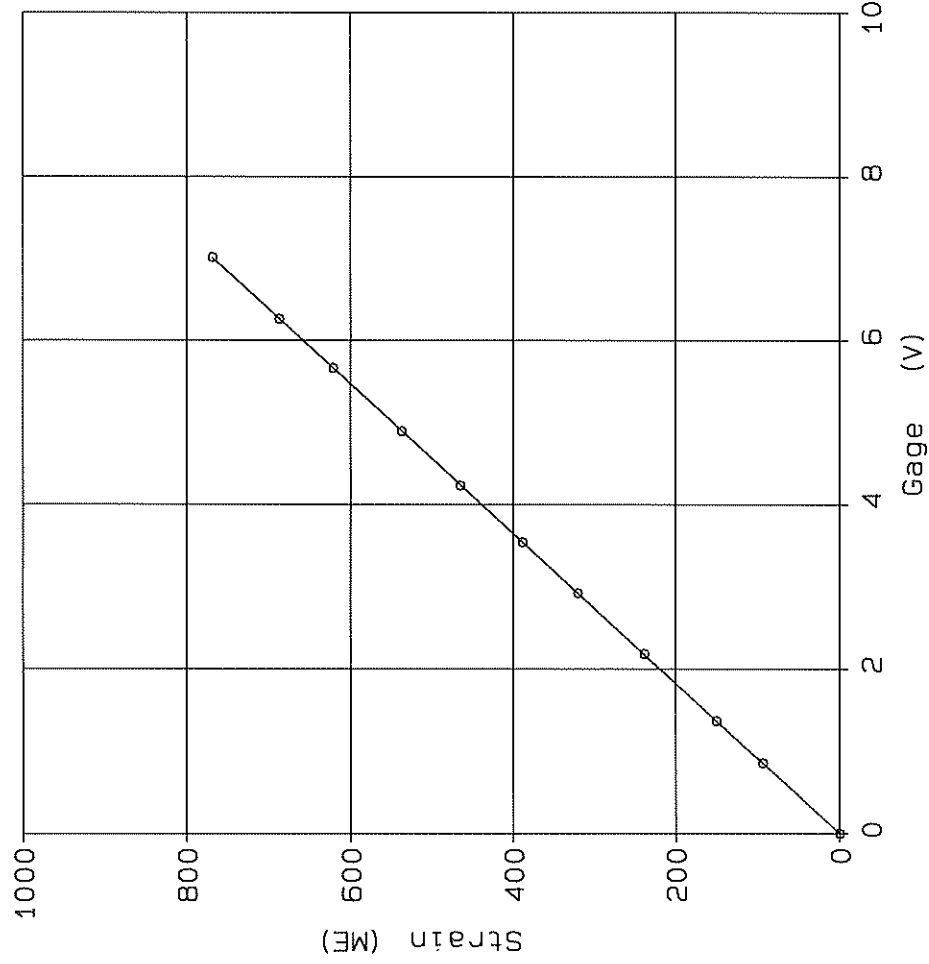

PDA Cal Factor = 109.7 ME/V
 Shunt (60.4KΩ) = 5.0 V
 General Factor = 380.9 ME/mV/V
 Traceable to N.I.S.T.

Strain ME	Gage V
0	.00
95	.86
150	1.37
239	2.18
320	2.93
389	3.54
465	4.24
537	4.90
622	5.67
687	6.26
769	7.01

Calibrated by: B. Eason
 Calibrated on: 09-Feb-01