


Pile Dynamics, Inc. Transducer 5185

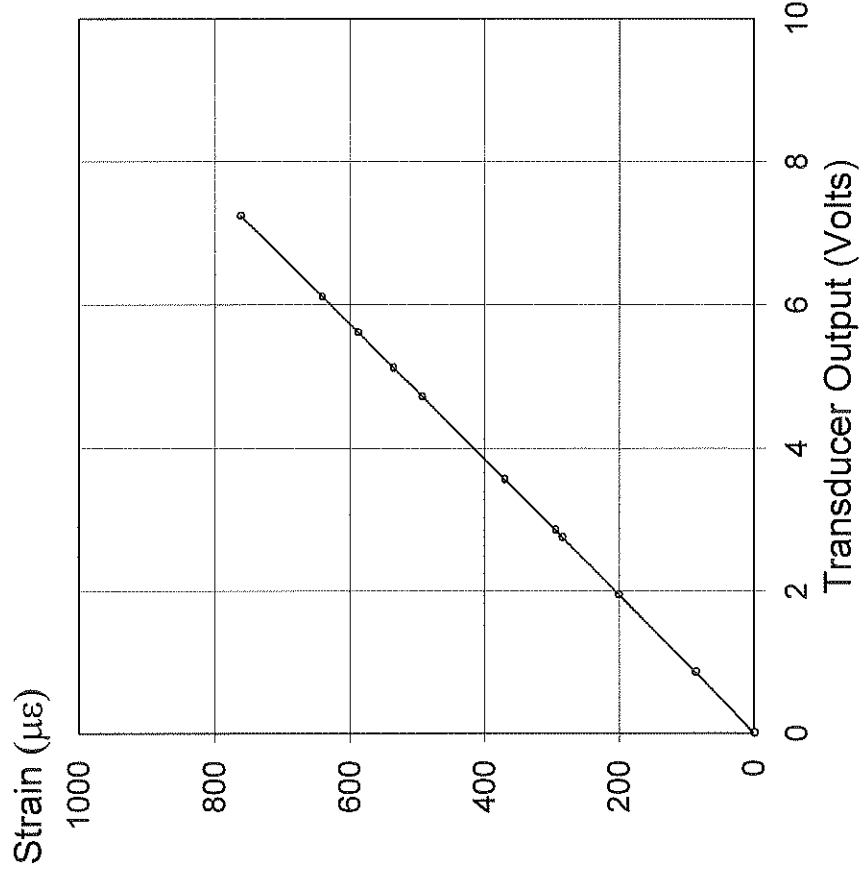

PDA Cal Factor 105.4 $\mu\epsilon$ /V

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
87	0.85
201	1.95
284	2.75
294	2.85
369	3.56
493	4.72
535	5.12
588	5.61
641	6.11
763	7.24

Shunt (60.4 K Ω) 5.0 V
General Factor 366.0 $\mu\epsilon$ /mV/V

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2004 Version 1.2

Calibrated by: G. J. H. H. H.
Calibrated on: 05-Aug-2005