




Pile Dynamics, Inc.

Pile Dynamics, Inc.

Transducer A175

Strain ($\mu\epsilon$)

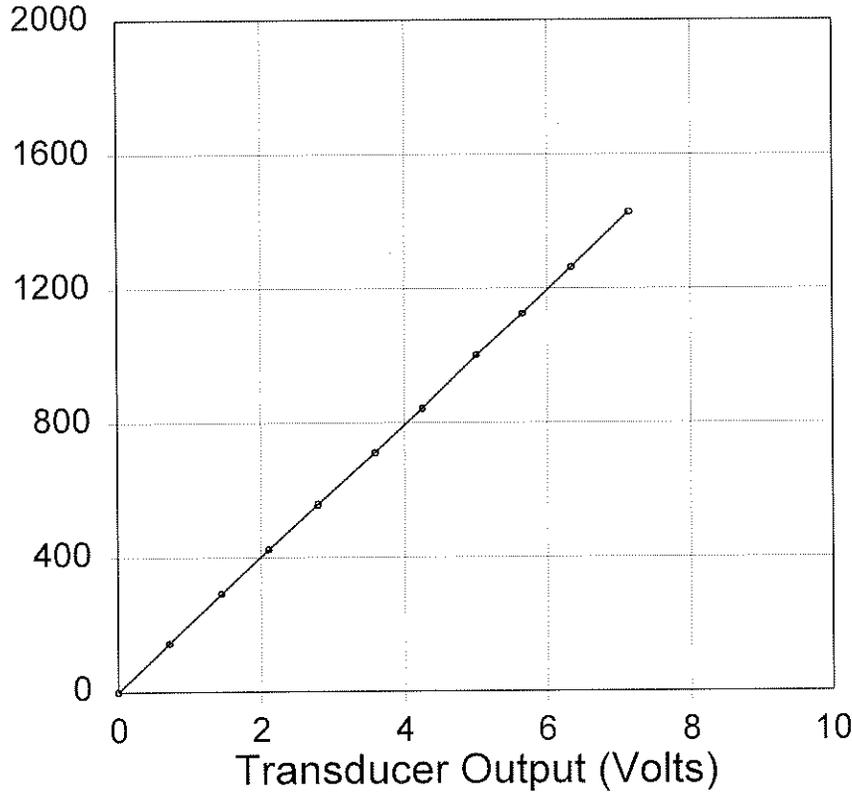

PDA Cal Factor (5.0 V) 99.6 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
144	0.71
290	1.45
422	2.11
557	2.79
710	3.58
842	4.25
1000	5.01
1125	5.65
1262	6.34
1427	7.14

Shunt (60.4 K Ω) 2.5 V
General Factor 345.8 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2004 Version 1.2

Calibrated by: *[Signature]*
Calibrated on: 02-Jun-2006