




Pile Dynamics, Inc.

Transducer B645

Strain ($\mu\epsilon$)

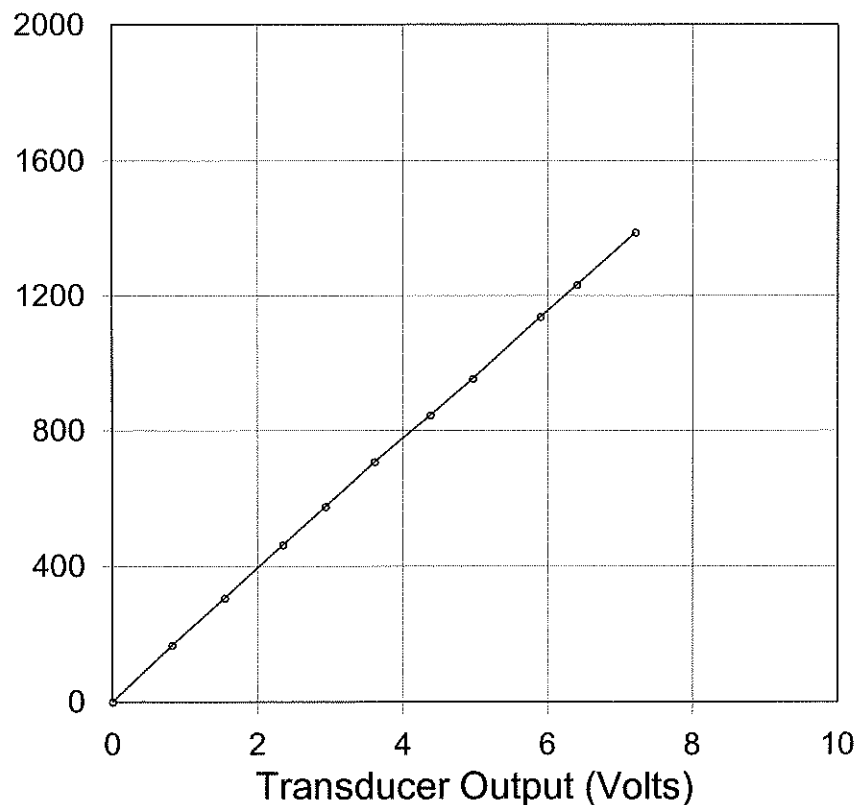

PDA Cal Factor (5.0 V)

95.6 $\mu\epsilon$ /V

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
167	0.81
307	1.54
463	2.34
575	2.93
706	3.61
846	4.37
953	4.96
1137	5.89
1233	6.40
1389	7.22

Shunt (60.4 K Ω)

2.5 V

General Factor

332.0 $\mu\epsilon$ /mV/V

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2009 Version 1.3

Calibrated by:

Calibrated on:

James Dehoff
15-Feb-2010