




Pile Dynamics, Inc.

Transducer B646

Strain ($\mu\epsilon$)

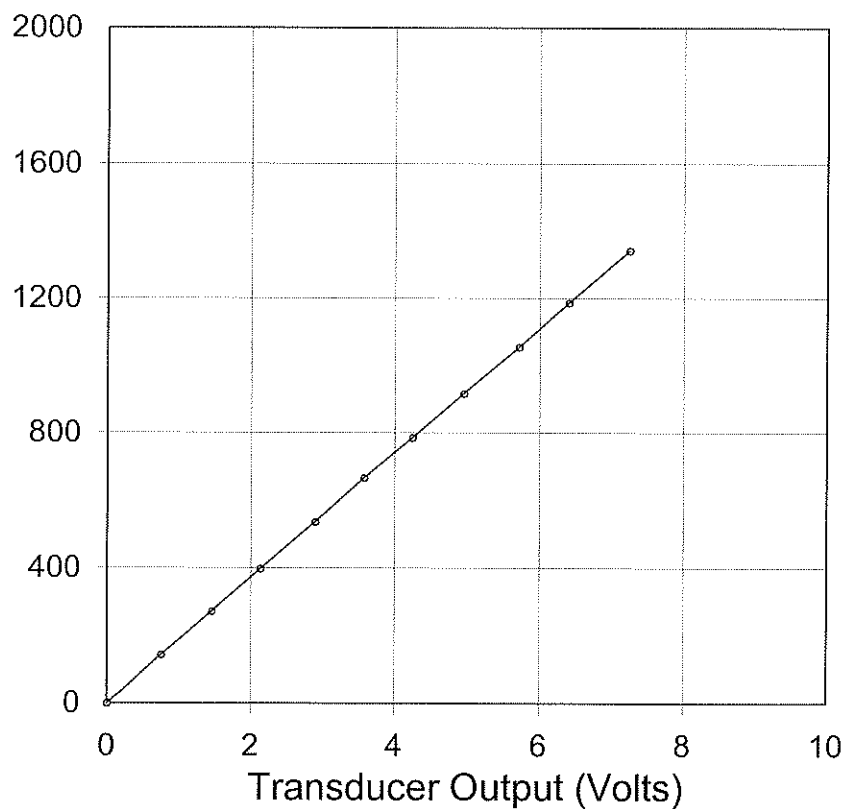

PDA Cal Factor (5.0 V)

92.4 $\mu\epsilon$ /V

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
143	0.74
272	1.45
397	2.13
536	2.89
665	3.57
785	4.24
916	4.95
1055	5.71
1186	6.40
1343	7.24

Shunt (60.4 K Ω)

2.5 V

General Factor

320.8 $\mu\epsilon$ /mV/V

Calibrated by:

Calibrated on:

Signature
20-Jul-2007

Traceable to N.I.S.T.