




Pile Dynamics, Inc.

Transducer B652

Strain ($\mu\epsilon$)

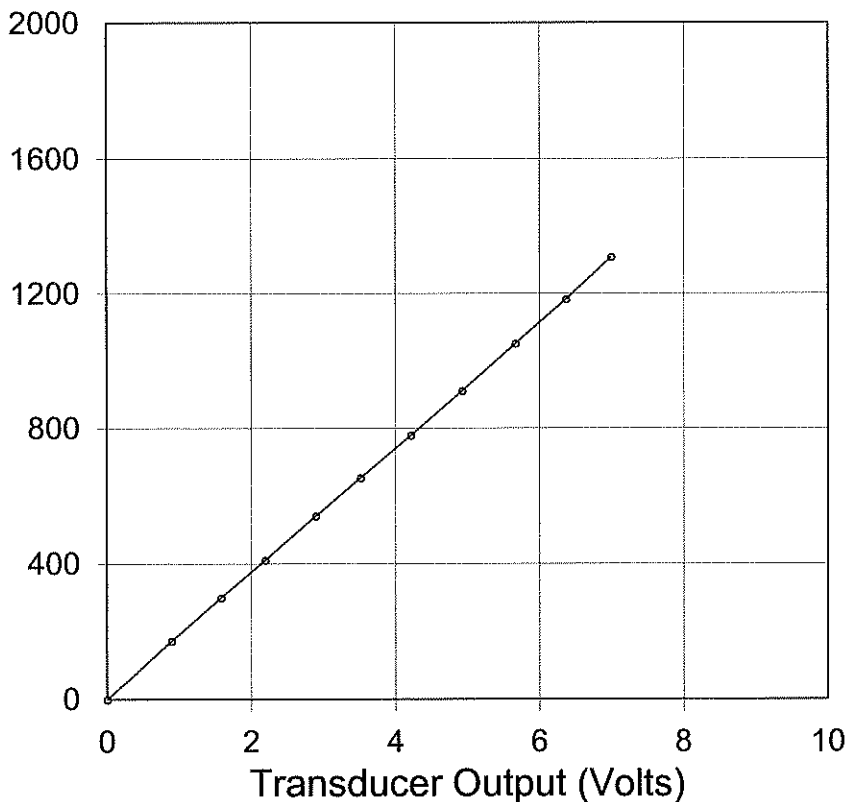

PDA Cal Factor (5.0 V)

92.8 $\mu\epsilon$ /V

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
171	0.88
301	1.58
409	2.19
541	2.89
652	3.51
779	4.21
911	4.92
1052	5.67
1184	6.36
1309	6.99

Shunt (60.4 K Ω)

2.5 V

General Factor

322.2 $\mu\epsilon$ /mV/V

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2004 Version 1.2

Calibrated by:

Calibrated on:

09-Jan-2008