




Pile Dynamics, Inc.

Transducer B655

Strain ($\mu\epsilon$)

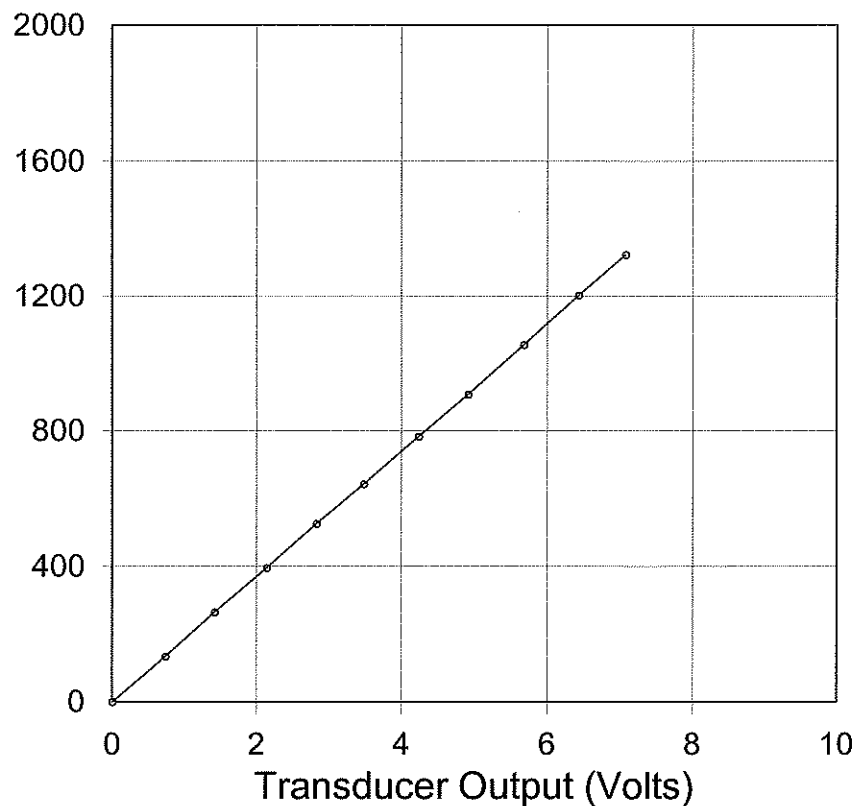

PDA Cal Factor (5.0 V)

93.4 $\mu\epsilon$ /V

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
136	0.73
264	1.41
395	2.14
524	2.83
641	3.47
782	4.23
908	4.91
1055	5.67
1202	6.43
1324	7.07

Shunt (60.4 K Ω)

General Factor

2.5 V

324.4 $\mu\epsilon$ /mV/V

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2004 Version 1.2

Calibrated by:

Calibrated on:

Shack
14-Dec-2007