




Pile Dynamics, Inc.

Transducer B984

Strain ($\mu\epsilon$)

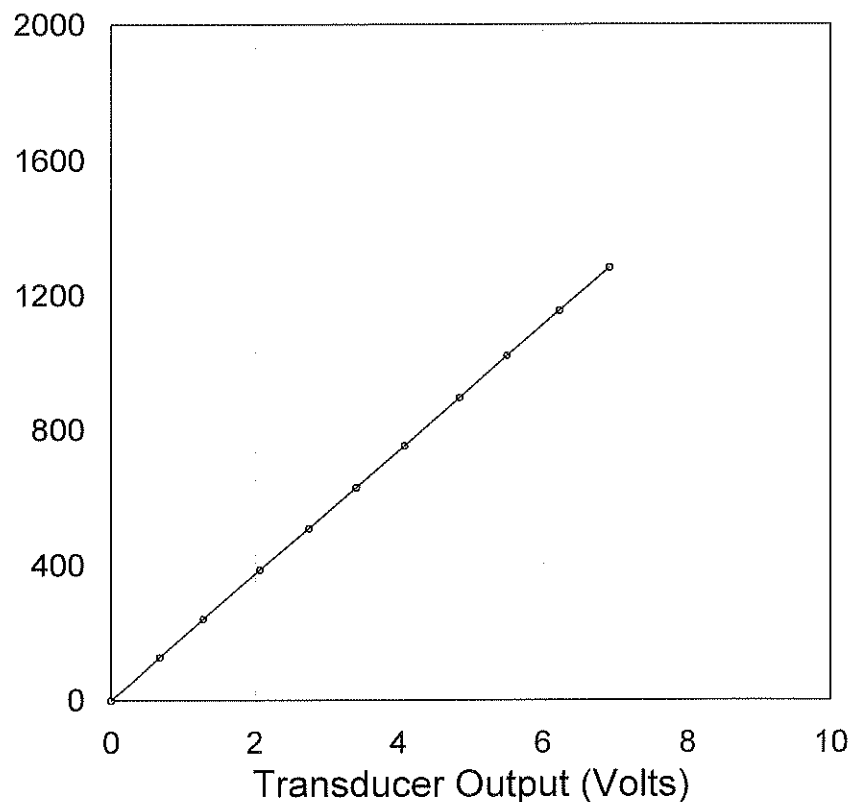

PDA Cal Factor (5.0 V)

92.4 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
128	0.67
242	1.28
385	2.07
509	2.76
630	3.40
753	4.07
894	4.84
1020	5.50
1154	6.23
1282	6.92

Shunt (60.4 K Ω)

2.5 V

General Factor

320.9 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on: 21-Sep-2011