




Pile Dynamics, Inc.

Transducer B985

Strain ($\mu\epsilon$)

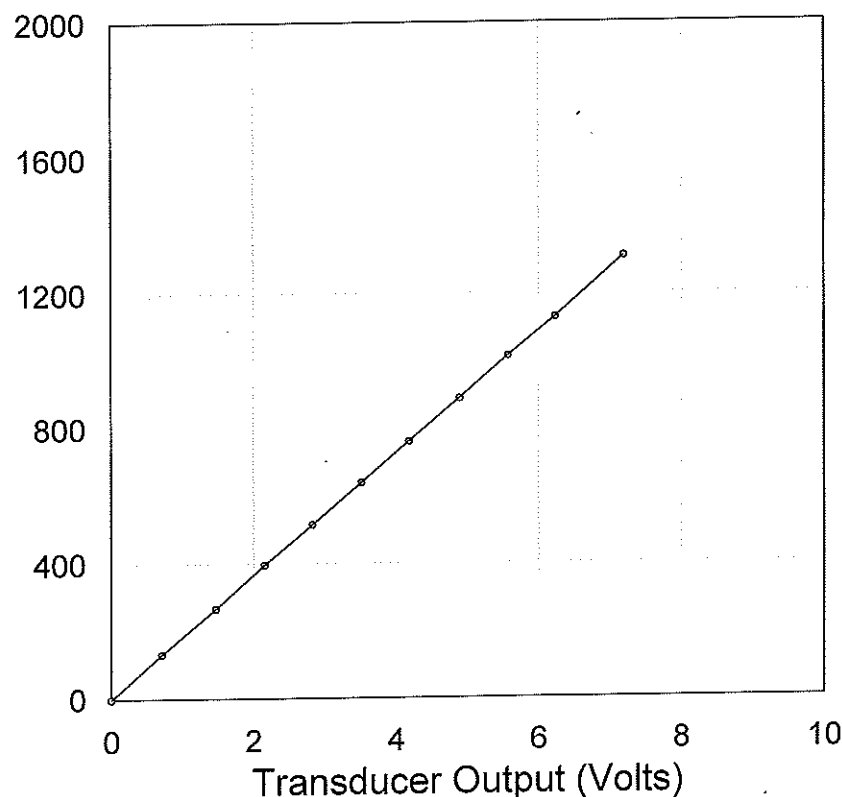

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2011 Version 1.5

PDA Cal Factor (5.0 V)

90.6 $\mu\epsilon$ /V

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
132	0.71
268	1.47
395	2.15
514	2.82
638	3.51
758	4.18
886	4.89
1012	5.57
1128	6.22
1309	7.20

Shunt (60.4 K Ω)

2.5 V

General Factor

314.6 $\mu\epsilon$ /mV/V

Calibrated by: E.S. Scott

Calibrated on: 10-Jul-2012

Smart Sensor? ☒ Yes ☐ No Smart Chip

Programmed by: E.S. Date: 7-10-12 CRC value 8FF3