




Pile Dynamics, Inc.

Transducer B987

Strain ($\mu\epsilon$)

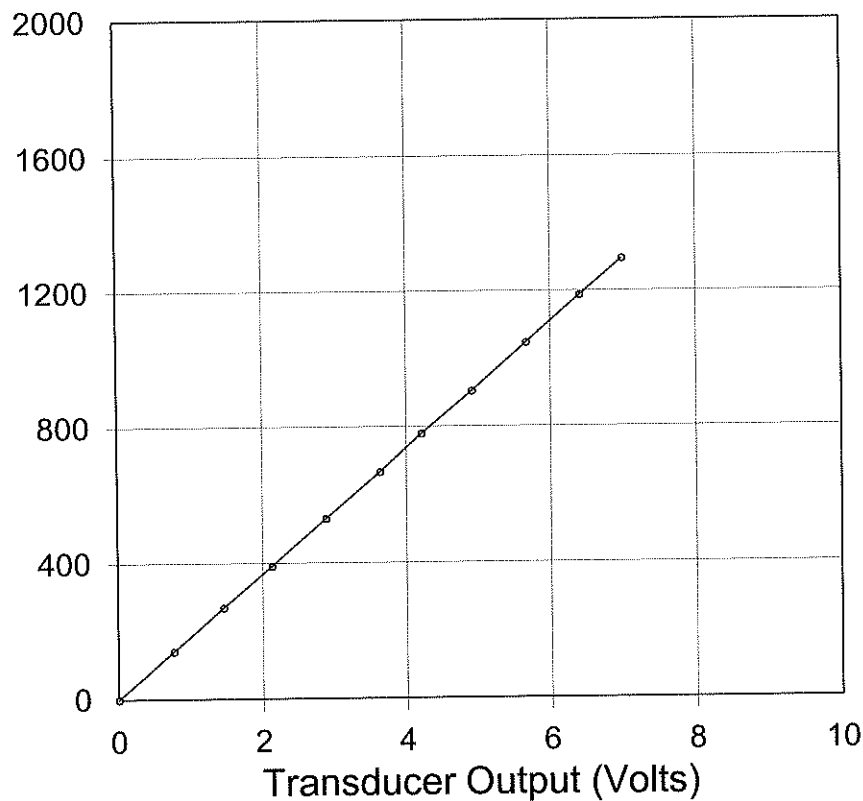

PDA Cal Factor (5.0 V)

92.7 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
142	0.76
270	1.45
392	2.13
529	2.88
666	3.63
778	4.21
904	4.91
1046	5.66
1188	6.40
1296	6.99

Shunt (60.4 K Ω)
General Factor

2.5 V

321.8 $\mu\epsilon/mV/V$

Calibrated by:

Calibrated on:

Strach
04-Dec-2007

Traceable to N.I.S.T.

Strain Transducer Calibrator System 2004 Version 1.2