




Pile Dynamics, Inc.

Transducer

B993

Strain ($\mu\epsilon$)

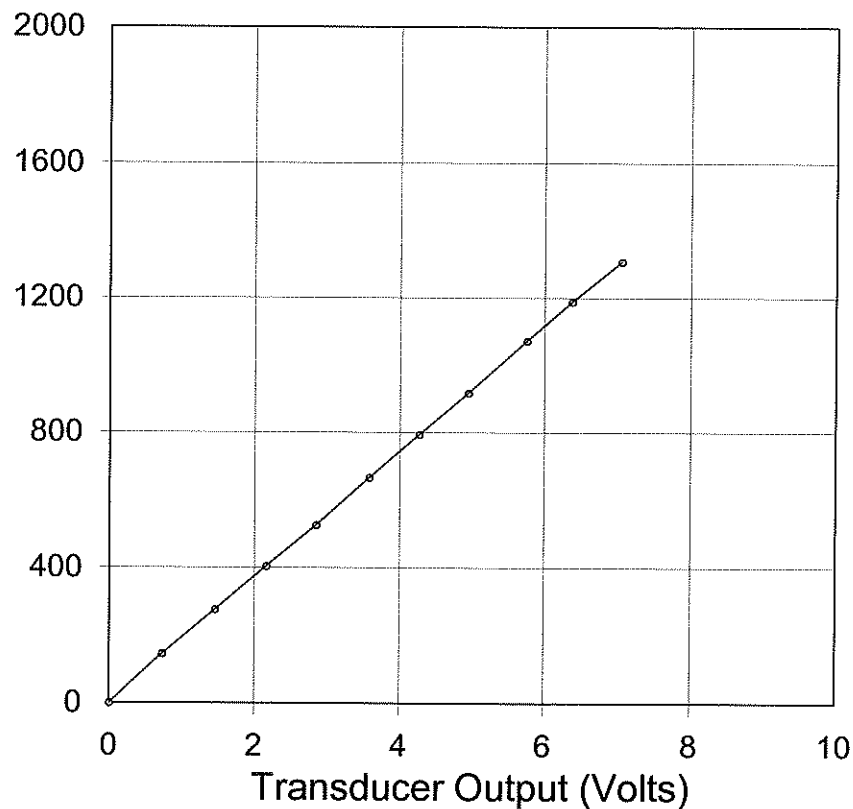

PDA Cal Factor (5.0 V)

92.7 $\mu\epsilon/V$

Applied Strain ($\mu\epsilon$)	Transducer Output (Volts)
0	0.00
147	0.73
277	1.45
405	2.16
526	2.84
665	3.57
793	4.26
916	4.94
1072	5.75
1188	6.37
1309	7.05

Shunt (60.4 K Ω)

2.5 V

General Factor

321.7 $\mu\epsilon/mV/V$

Traceable to N.I.S.T.

Calibrated by:

Calibrated on:

05-Sep-2008